
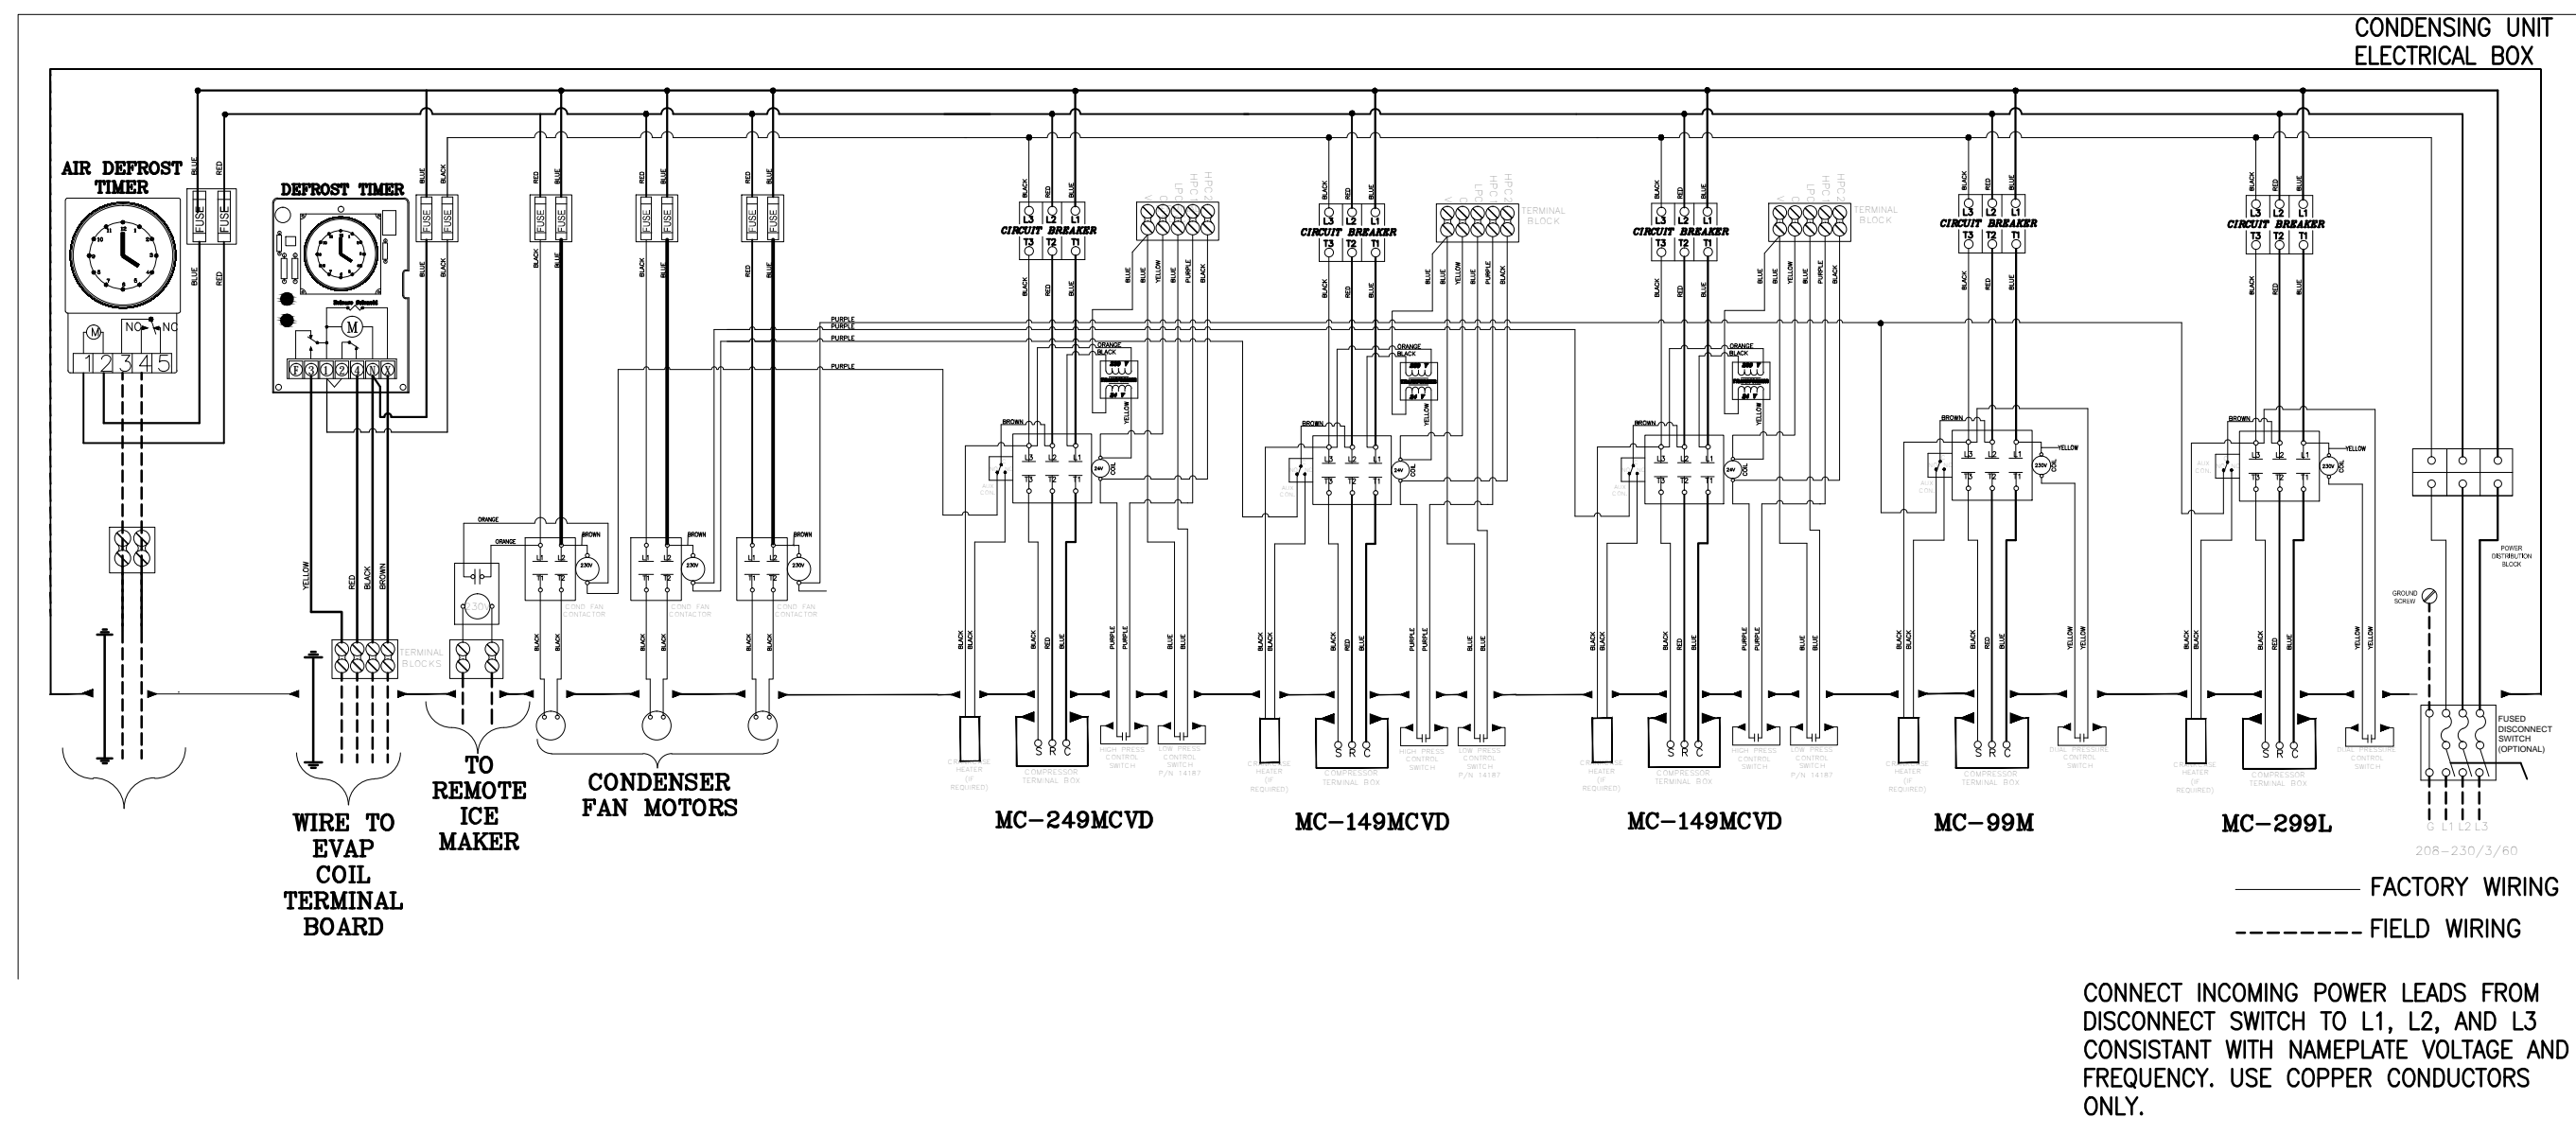


EQUIPMENT SCHEDULE


#	QUANTITY	PROVIDED BY	INSTALLED BY	EQUIPMENT			PLUMBING				ELECTRICAL			REMARKS
				DESCRIPTION	MANUFACTURER / MODEL NO.	DIMENSIONS	HOT WATER	COLD WATER	WASTE INDIRECT	WASTE DIRECT	GAS	VOLT/PH	AMPS (A) WATTS(W)	
1	1	OWNER	KEC, PC, EC	MAIN COOK COUNTER	CUSTOM STAINLESS STEEL MFR.	--	--	--	--	--	208/3	35.6A	--	ETL & UL MFR FIXTURE
2	1	OWNER	KEC	SHAKE SYRUP RACK	--	--	--	--	--	--	--	--	--	--
3	1	OWNER	KEC	BROILER CART	WASSERSTROM	31" X 35" X 35"	--	--	--	--	--	--	--	--
4	1	OWNER	KEC, EC	FRY DUMP & BASE	CUSTOM STAINLESS STEEL MFR.	32" X 48"	--	--	--	--	120/1	2680W	--	--
5	1	OWNER	KEC, PC, EC	BACK COOK COUNTER	FIXTURE DESIGN & MFG.	100" X 64" X 33"	--	--	--	--	208/3	57.2A	--	--
6	1	OWNER	KEC, PC	POST WASH SINK & VEGETABLE SINK	FIXTURE DESIGN & MFG.	134" X 27" X 37"	1/2"	1/2"	2"	--	--	--	--	--
7	1	OWNER	KEC	WORK TABLE	METRO / #CJPTG4	48" X 30" X 34"	--	--	--	--	120/1	900W	--	--
8	1	OWNER	KEC	WIRE RACK SYSTEM ABOVE POT SINKS	METRO	--	--	--	--	--	--	--	--	--
9	1	OWNER	KEC	DRIVE THRU DRINK SERVICE COUNTER	FIXTURE DESIGN & MFG.	80" X 38" X 35"	--	--	--	--	--	--	--	--
10	1	OWNER	KEC	GRIDDLE STAND	WASSERSTROM	--	--	--	--	--	--	--	--	--
11	1	OWNER	KEC	DISPLAY MOUNT LID DISPENSER	--	--	--	--	--	--	--	--	--	--
12	1	OWNER	KEC	SELF SERVE DRINK CABINET	FIXTURE DESIGN & MFG.	111" X 42" X 36"	--	--	--	--	--	--	--	--
13	1	OWNER	GC	DRIVE THRU WINDOW (SS TOP)	--	--	--	--	--	--	--	--	--	--
14	2	OWNER	KEC, EC	BISCUIT OVEN	BLODGETT CTB	30" X 25"	--	--	--	--	208/3	(2)@ .6KW EA.	--	--
16	0	OWNER	KEC	SHELF UNIT W/ SS TOP	METRO / #CJDTOSS	60" X 18" X 74"	--	--	--	--	--	--	--	--
16A	1	OWNER	KEC	SHELF UNIT W/ SS TOP	METRO / #CJDTOSS3	36" X 18" X 74"	--	--	--	--	--	--	--	AT ALT. DRIVE-THRU
16B	1	OWNER	KEC	SHELF UNIT W/ SS TOP	METRO / #CJDTOSS2	24" X 18" X 74"	--	--	--	--	--	--	--	AT ALT. DRIVE-THRU
17	1	OWNER	KEC	MISC. STAINLESS STEEL DIVIDERS	FIXTURE DESIGN & MFG.	--	--	--	--	--	--	--	--	--
18	1	OWNER	KEC	ORDER COUNTER CABINETS	--	--	--	--	--	--	--	--	--	--
19	1	OWNER	KEC, EC	BISCUIT WARMER	--	--	--	--	--	--	--	--	--	--
20	2	OWNER	OPS	CONDIMENT STAND AND LID DISPENSER	--	--	--	--	--	--	--	--	--	--
21	1	OWNER	KEC	ICE CREAM FREEZER STAINLESS INSERT	FIXTURE DESIGN & MFG.	16" X 7" X 1"	--	--	--	--	--	--	--	--
22	1	OWNER	KEC	"BAG-IN-BOX" RACK	--	--	--	--	--	--	--	--	--	--
23	5	OWNER	KEC	STAINLESS STEEL JAMBS	--	--	--	--	--	--	--	--	--	--
24	--	--	--	--	--	--	--	--	--	--	--	--	--	--
25	1	OWNER	KEC	DROP IN STEAMER AT BACK LINE	WELLS / MOD-100TD	22" X 14" X 10"	--	1/2"	3/4"	--	208/3	6A	--	--
26	1	OWNER	KEC	SHAKE BLENDER	HAMILTON BEACH / 94950	25" X 10" X 8"	--	--	--	--	120/1	1600W	--	--
27	1	OWNER	KEC	STAINLESS STEEL PREP COUNTER & SHELF	FIXTURE DESIGN & MFG.	100" X 33" X 64"	--	--	--	--	--	--	--	--
28	1	OWNER	KEC	TIMER FOR GRIDDLE	FRYMASTER / COMPUTER MAGIC III	--	--	--	--	--	120/1	2A	--	--
29	3	OWNER	KEC	HAND SINK W/ S.S. SPLASH SCREEN	UNIVERSAL / HSE-11RL-WB	16" X 16 3/4"	1/2"	1/2"	2"	--	--	--	--	TEMPERED
30	1	OWNER	KEC, EC	MEAT FREEZER	SILVER KING / SKMF34	36" X 25" X 33"	--	--	--	--	120/1	2.5A	1/4	--
31	1	OWNER	KEC, PC, EC	CHARBROILER	NECO / 1424G	44" X 31" X 29"	--	--	--	1" (100MBH)	120/208	18A	--	30A BRAKER
32	1	OWNER	KEC	FOOD WARMER	WELLS / MOD-200TD	29" X 24" X 10"	1/2"	--	3/4"	--	208/3	6A	--	SUBPANEL-MAIN COOKLINE
33	1	OWNER	VENDOR	DRIVE THRU WIRELESS RADIO SYSTEM	HME / ODYSSEY IQ	--	--	--	--	--	120/1	10A	--	--
34	1	OWNER	KEC	SANDWICH HOLDING UNIT	BKI / SM-51R	51" X 17" X 47"	--	--	--	--	120/1	10A	--	SUBPANEL-MAIN COOKLINE
35	1	OWNER	KEC, PC, EC	3-BAY FRYER WITH FILTER UNIT	PITCO / SGH50	46" X 20" X 46"	--	--	--	1 1/2" (240MBH)	120/1	960W	--	--
36	1	OWNER	KEC	SHAKE PREP STATION	FIXTURE DESIGN & MFG.	40" X 36" X 36"	--	--	--	--	--	--	--	--
37	--	--	--	SPACE LEFT BLANK	--	--	--	--	--	--	--	--	--	--
38	1	OWNER	KEC, PC	48" GRIDDLE UNIT	JADE / JGT-2448C	48" X 28" X 36"	--	--	--	3/4" (96MBH)	120/1	13.8A	--	--
39	1 LOT	OWNER	KEC	STAINLESS STEEL PANELS; QUILTED OR BRUSHED	FIXTURE DESIGN & MFG.	--	--	--	--	--	--	--	--	SEE INTERIOR ELEVATIONS
40	2	OWNER	PC, EC	SELF-SERVE DRINK DISPENSER UNIT	BY COKE VENDOR	--	--	1/2" *	--	--	120/1	2.5A	--	FILTERED WATER
41	1 LOT	OWNER	KEC	SHELVING	METRO	--	--	--	--	--	--	--	--	--
42	1 LOT	OWNER	KEC	COOLER/FREEZER SHELVING	METRO	--	--	--	--	--	--	--	--	--
43	2	OWNER	GC	WATER FILTER	--	--	--	--	--	--	--	--	--	SEE PLUMBING
44	2	OWNER	KEC	THAW RACK	NEWAGE / 95814	20" X 69" X 14"	--	--	--	--	--	--	--	--
45	1	OWNER	KEC	FRY BASKET RACK	HED / 00022871	25" X 16" X 49"	--	--	--	--	--	--	--	--
46	1	OWNER	KEC, PC	PRE-RINSE UNIT	--	--	1/2"	1/2"	--	--	--	--	--	--
47A	1	OWNER	KEC	GRIDDLE HOOD	GRIDDLE HOOD	52"X30"	--	--	--	--	--	--	--	--
47B	1	OWNER	KEC	FRYER HOOD	FRYER HOOD	51" X 26"	--	--	--	--	--	--	--	--
47C	1	OWNER	KEC	BROILER HOOD	BROILER HOOD	39" X 48"	--	--	--	--	--	--	--	--
48	3	OWNER	KEC, PC	QUICK DISCONNECT SOCKET, PLUG, HOSE, AND STRAP	DORMONT	--	--	--	--	--	--	--	--	INSTALL BY P.C. (3) APPLIANCES
49	1	OWNER	KEC	ICE CREAM FREEZER	SILVER KING / SKMF34	36" X 25" X 33"	--	--	--	--	120/1	300W	--	--
50	3	OWNER	KEC	S/S CORNER GUARDS	--	--	--	--	--	--	--	--	--	RE:
51A	1	OWNER	KEC	HOT HOLD CABINET (MAIN COOK LINE)	PRINCE CASTLE / DHB2PT-33	33"X14"X12"	--	--	--	--	120/1	2600W	--	--
51B	1	OWNER	KEC	HOT HOLD CABINET (FRY DUMP BASE)	PRINCE CASTLE / DHB2PT-27	--	--	--	--	--	120/1	1650W	--	--
52	1	OWNER	KEC	WASTE SHORTENING CONTAINER	--	--	--	--	--	--	--	--	--	--
53	1	OWNER	MFR, PC, EC	COOLER UNIT	SEE PLANS	--	--	--	--	--	120/1	216W	--	--
53B	1	OWNER	MFR, PC, EC	COOLER EVAPORATOR UNIT	SA28-106	37"X45.5"	--	--	--	--	208/1	2.0A	--	--
53C	4	OWNER	MFR, PC, EC	COOLER LIGHTING	BY COOLER VENDOR	--	--	--	--	--	--	--	--	VAPOR PROOF
54	1	OWNER	MFR, PC, EC	FREEZER UNIT	INTERNATIONAL COLD STORAGE	SEE PLANS	--	--	--	--	120/1	700W	--	--
54B	1	OWNER	MFR, PC, EC	FREEZER EVAPORATOR UNIT	SA26-115	--	--	--	--	--	208/1	2.0A	--	--
54C	4	OWNER	MFR, PC, EC	FREEZER LIGHTING	BY COOLER VENDOR	--	--	--	--	--	--	--	--	VAPOR PROOF
54D	1	OWNER	MFR, PC, EC	FREEZER DEFROST UNIT	SA26-92	--	--	--	--	--	208/1	8.7A	--	--
55A	1	OWNER	MFR, PC, EC	COFFEE BREWER	CURTIS / CBS	17" X 9" X 34"	--	1/2"	--	--	120/1	20A / 1800W	--	FILTERED WATER
55B	6	OWNER	MFR, PC, EC	COFFEE AIR POTS	CURTIS / TLXA22	--	--	--	--	--	--	--	--	--
55C	1	OWNER	MFR, PC, EC	COFFEE BREWER RACK	CURTIS / CAR-4-BLK	--	--	--	--	--	--	--	--	--
56	2	DC	OPS	TEA DISPENSER	CURTIS / TCO-421	16" X 15" X 22"	--	1/2" *	--	--	--	--	--	FILTERED WATER
57	2	OWNER	KEC, EC	MICROWAVE	PANASONIC / NE-1757	16" X 20" X 13"	--	--	--	--	120/1	15A	--	BASIC LINE SUB-PANEL
58A	1	OWNER	DRINK SYSTEM	BY COKE VENDOR	--	--	--	--	--	--	--	--	--	--
58B	1	OWNER	DRINK SYSTEM - DISPENSER @ D.T.	BY COKE VENDOR	--	--	1/2" *	3/4"	--	--	--	--	--	FILTERED WATER
58C	1	OWNER	DRINK SYSTEM - CARBONATOR	BY COKE VENDOR	--	--	--	--	--	--	--	--	--	--
58D	1	OWNER	DRINK SYSTEM - LINE KIT	BY COKE VENDOR	--	--	--	--	--	--	--	--	--	SEE "E" SHEETS FOR CONDUIT
59	1	OWNER	MFR, EC, PC	ICE MACHINE	MANITOWOC / S-SERIES 600	30" X 34" X 65"	--	1/2"	3/4"	--	208/3	12.8A	--	FILTERED WATER
59A	3	OWNER	MFR, EC, PC	AUTOMATIC CLEANING SYSTEM	AUCS-SI	--	--	--	--	--	--	--	--	--
60	2	OWNER	PC, EC	ICE MACHINE SELF-SERV	MANITOWOC / IB-0684YC	--	--	1/2" *	3/4"	--	120/1	1.1A	--	FILTERED WATER
62	3	OWNER	KEC	SS HOLDERS FOR DAY DOTS & WRAPS	--	--	--	--	--	--	--	--	--	--
63	1 LOT	OWNER	GC	CUP DISPENSERS	EZ-FIT / C2410C18	2" X 4" X 18"	--	--	--	--	--	--	--	IN UNDER CABINET UNITS REFER TO PLUMBING DRAWINGS
64	1	OWNER	PC	MOP SINK	--	24" X 24" X 6"	1/2"	1/2"	3"	--	--	--	--	--
65	1	OWNER	KEC	HINGED GLASS DOOR LUMAVUE	BEVERAGE-AIR / LV12	24" X 24" X 62"	--	--	--	--	120/1	4.6A	1/5	--
66	1	OWNER	MFR, EC	MUSIC SYSTEM	--	--	--	--	--	--	120/1	10A	--	IN CABINET
67	1	OWNER	GC	EMPLOYEE LOCKERS (IF APPLICABLE)	--	--	--	--	--	--	--	--	--	--
68	5	OWNER	POS	COMPUTER CASH REGISTERS	--	--	--	--	--	--	120/1	1A	--	--
69	2	OWNER	POS	SPEED OF SERVICE LOOP SYSTEM	QTIMER	--	--	--	--	--	120/1	0.5A	--	@ D.T. WDW & O.C.B.
70	1	OWNER	GC	UNDER-COUNTER SAFE	AMSEC / 9335710	19" X 17" X 30"	--	--	--	--	120/1	1A	--	--
71	1	OWNER	--	TRAINING COMPUTER	--	16" X 15" X 15"	--	--	--	--	120/1	70W	--	--

EQUIPMENT SCHEDULE (CONTINUED)

#	QUANTITY	PROVIDED BY	INSTALLED BY	EQUIPMENT			PLUMBING				ELECTRICAL			REMARKS
				DESCRIPTION	MANUFACTURER / MODEL NO.	DIMENSIONS	HOT WATER	COLD WATER	WASTE INDIRECT	WASTE DIRECT	GAS	VOLT/PH	AMPS (A) WATTS(W)	
71A	1	OWNER	SC	TRAINING CENTER	--	--	--	--	--	--	--	--	--	SEE ELEV. 2/A2.3
72	1	OWNER	KEC	HALF SIZE REFRIG. BASE WITH COLD TOP	McCALL / ST-27-2	27" X 26" X 45"	--	--	--	--	120/1	15A	--	BACKLINE SUB-PANEL
73	1	OWNER	OWNER	OFFICE CHAIR	--	--	--	--	--	--	--	--	--	--
74	1	OWNER	KEC	REFRIGERATED BATTER TABLE	--	--	--	--	--	--	120/1	1.6A	--	--
75	--	DC	OPS	BOOSTER SEAT / HIGH CHAIR	BY SEATING VENDOR	--	--	--	--	--	--	--	--	--
76	--	OWNER	SC	DINING ROOM CHAIRS / STOOLS	BY SEATING VENDOR	--	--	--	--	--	--	--	--	--
77	3	OWNER	MFR, GC, EC	ANSUL FIRE PROTECTION SYSTEM AND EXTINGUISHERS	--	--	--	--	--	--	--	--	--	--
78	1	OWNER	OWNER	FIRST AID KIT	ZEE MEDICAL	--	--	--	--	--	--	--	--	--
79	1	OWNER	OWNER	POWER OUTAGE KIT	--	--	--	--	--	--	--	--	--	--
80	0	OWNER	KEC	SALSA BAR -- (ONLY IN GREEN BURRITO CONFIG.)	--	--	--	--	--	--	120/1	20A	--	--
81	1	OWNER	GC	ONION SLICER	NEMCO / #N55200AN	--	--	--	--	--	--	--	--	--
82	--	OWNER	GC	GRAPHICS ON WALLS	--	--	--	--	--	--	--	--	--	SEE A2.2
83	--	--	--	--	--	--	--	--	--	--	--	--	--	--
83A	--	--	--	--	--	--	--	--	--	--	--	--	--	--
84	1	GC	GC	WATER HEATER	--	--	--	--	--	--	--	--	--	SEE PLUMBING
85	1	OWNER	MFR	REFRIDGERATION SYSTEM	--	--	--	--	--	--	--	--	--	SEE K-2
86	1	OWNER	GC	CAN OPENER	--	--	--	--	--	--	--	--	--	--
87	1	OWNER	KEC, EC	UNDER-COUNTER REFRIGERATOR	RANDELL / 9404-7	27" X 30" X 36"	--	--	--	--	120/1	10A	--	--
88	1	OWNER	MFR	MENUBOARD	--	--	--	--	--	--	120/1	800W	--	--
89	1	OWNER	GC, MFR	BULK CO2 TANK WITH SERVICE ACCESS DOOR	NUCO2	--	--	--	--	--	--	--	--	--
90	3	OWNER	SC	TRASH STANDS WITH LINERS	BY SEATING VENDOR	--	--	--	--	--	--	--	--	--
91	--	OWNER	SC	CORE-DRILLED BASES	BY SEATING VENDOR	--	--	--	--	--	--	--	--	--
92	--	--	--	--	--	--	--	--	--	--	--	--	--	--
93	--	OWNER	SC	TABLE TOPS	BY SEATING VENDOR	--	--	--	--	--	--	--	--	--
94	--	OWNER	SC	BOOTHES	BY SEATING VENDOR	--	--	--	--	--</				

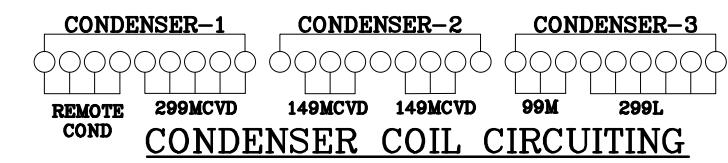

CONDENSING UNIT WIRING DIAGRAM
N.T.S. 2

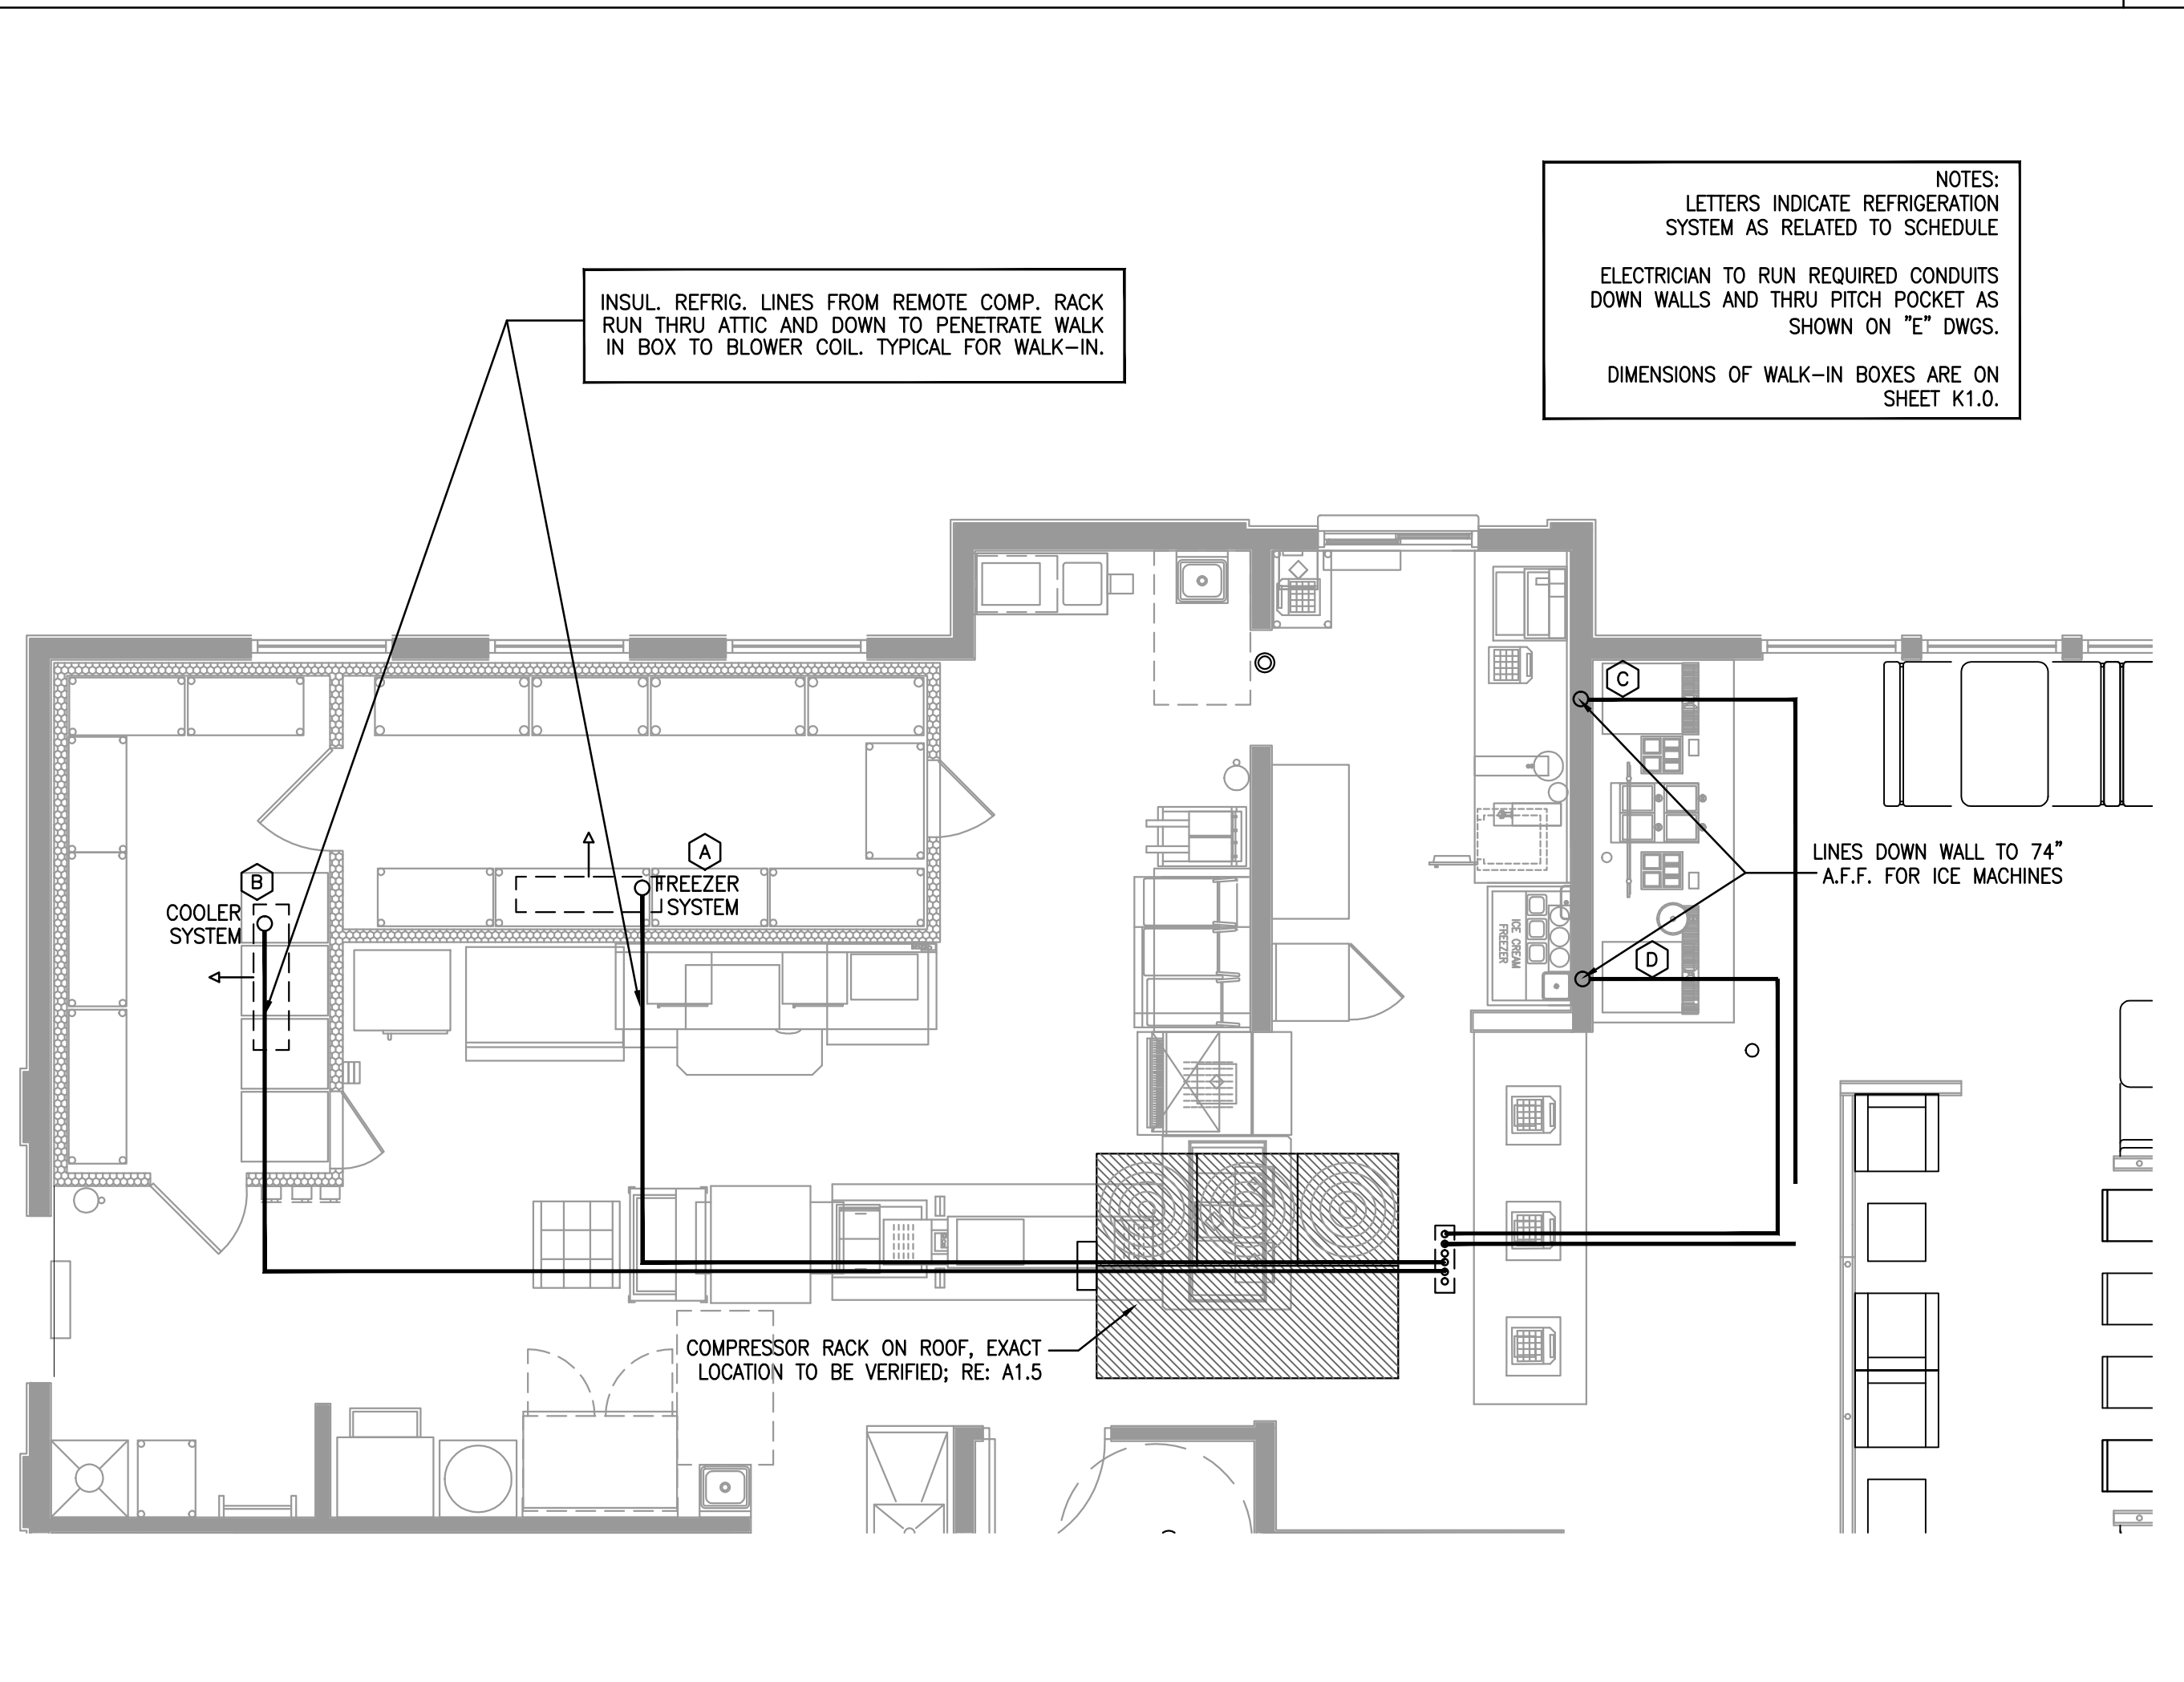

REFRIGERATION PLAN (VERIFY CONNECTIONS)
1/4"=1'-0" 7



SYSTEM	FIXTURE DESCRIPTION	TEMP F	REFRIG SUCC	COMPRESSOR	COND UNIT - RMT COND										UNIT COOLER										COND. UNIT		EVAPORATOR			ACCESSORIES																							
					MODEL NO	H P	COMPRESSOR		CONDENSER FAN MTR(S)	MBH @ 90°F AMBIENT	MAX FUSE SIZE	DEFROST QTY	MODEL NO	MFG	FAN 1Ø	HEATER	SUCT	LIQ	SUCT	LIQ	DRAIN	DEFROST CLOCK	CONTROLS	MTD																													
							RLA	V HZ																	Ø	Ø	Ø	Ø	Ø	Ø	Ø	Ø	Ø	Ø	Ø	Ø	Ø	Ø	Ø	Ø	Ø												
A	WALK-IN FREEZER	-10	-20	404A	CF12K6E-TF5	MC-299L	3.0	12.3	208	60	3		9.7	20	E 1	EL36-120	RDI	1.35	208	230	13.0	230	1	7/8"OD	3/8"OD	7/8"OD	3/8"OD	3/4 MPT	F	F	F	F																					
B	WALK-IN COOLER	35	25	404A	RS70C1E-TFC	MC-99M	1.0	4.7	208	60	3		11.9	15	O 1	AM26-87	RDI	1.8	115					7/8"OD	1/2"OD	7/8"OD	3/8"OD	3/4 MPT	F	F	F	F																					
C	IB0694YC	35	25	404A	CS07K0E-TF5	MC-149M	1.5	6.8	208	60	3		15		BY OTHERS								7/8"OD	1/2"OD																													
D	IY1474C ICE MACHINE	35	25	404A	CS14K6E-TF5	MC-299M	3.0	9.1	208	60	3		15		BY OTHERS								7/8"OD	1/2"OD																													
E	IB0694YC	35	25	404A	CS07K0E-TF5	MC-149M	1.5	6.8	208	60	3		15		BY OTHERS								7/8"OD	1/2"OD																													
F	CONDENSER CIRCUIT FOR KITCHEN ICE MAKER																																																				
G	CONDENSER FAN MOTOR																																																				
H	CONDENSER FAN MOTOR																																																				
I	CONDENSER FAN MOTOR																																																				

LEGEND
O = OFF CYCLE
E = ELECTRIC
A = AIR W/TIMER


Power Supply = 208-230/3/60
Total Connected Load = 47.3A
Minimum Circuit Ampacity = 50.3A
Maximum Overcurrent Protection = 60A
Approx. Condensing Unit Weight = 1300 lbs.

F = FACTORY INSTALLED
M = PROVIDED BY EQUIPMENT MANUFACTURER


ENGINEERING SUMMARY
N.T.S. 1

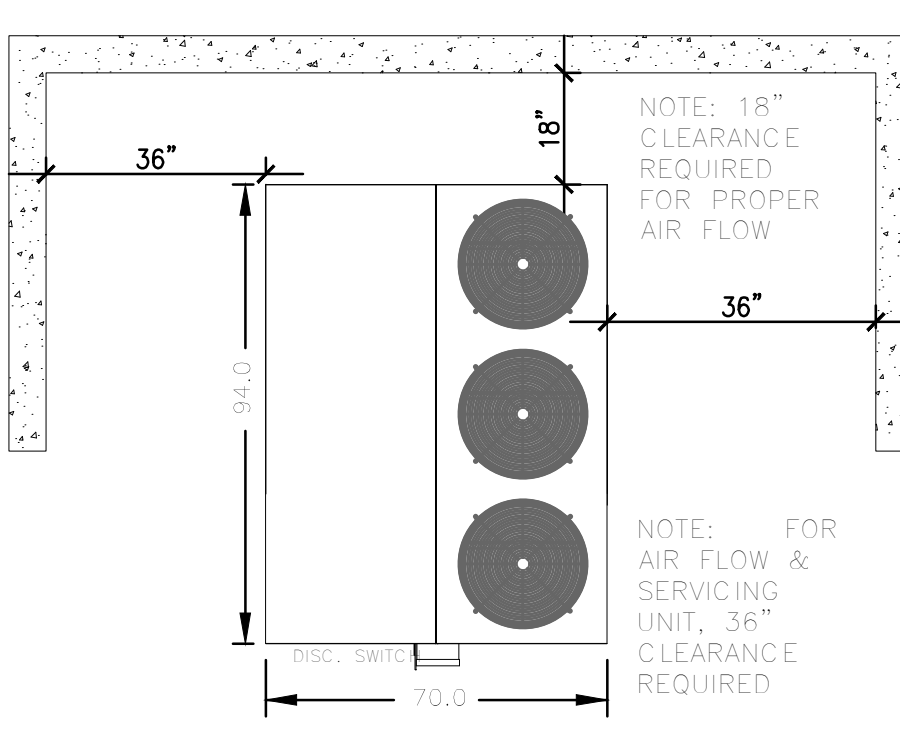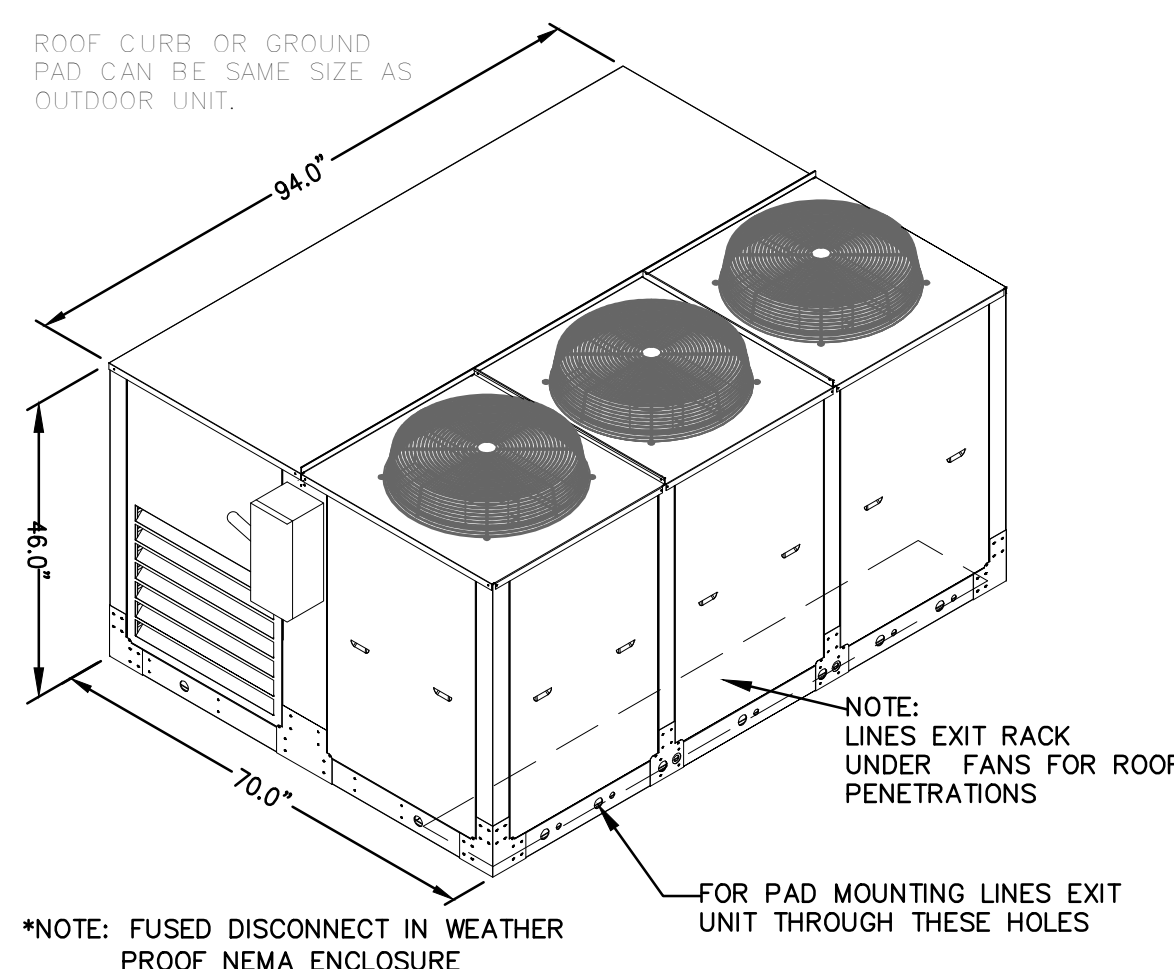


EQUIPMENT PROFILE
N.T.S. 3

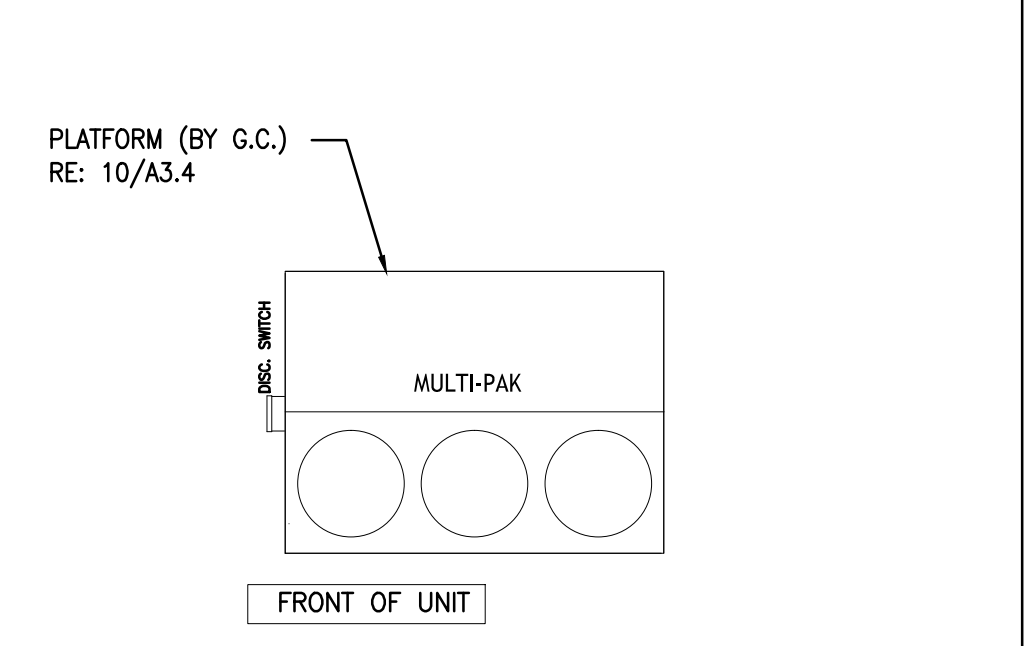


ROOF PLATFORM DETAILS
N.T.S. 4

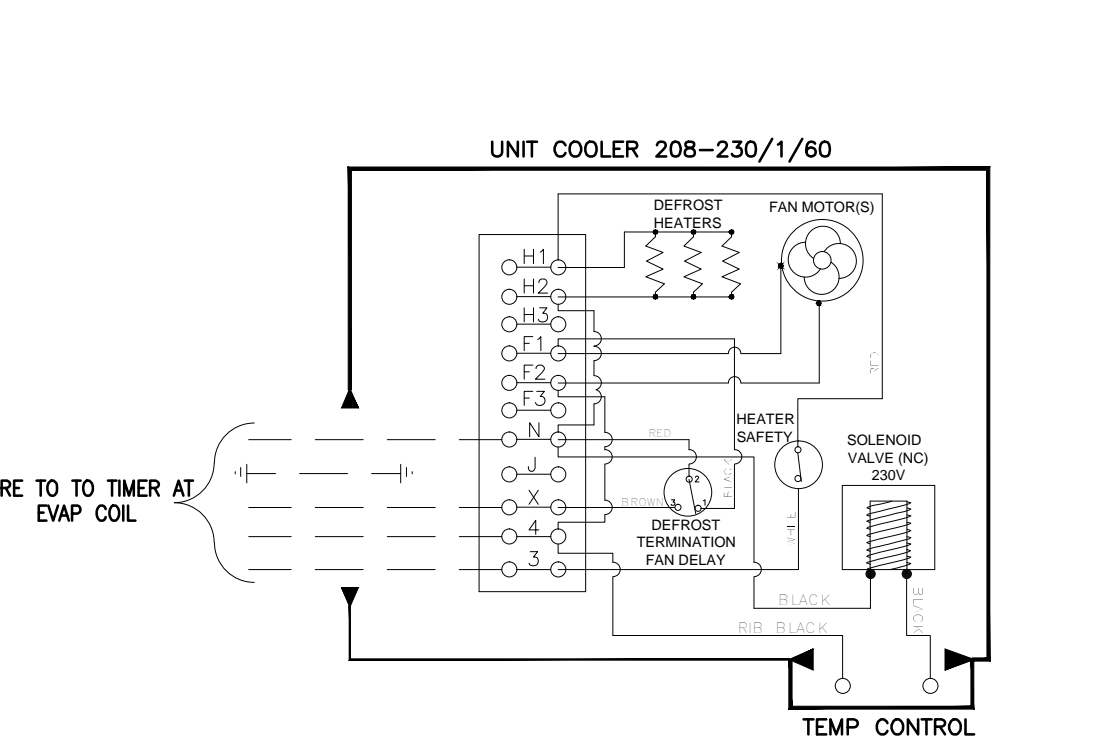

WIRING DIAGRAM ELEC. DEFROST EVAP.
N.T.S. 5

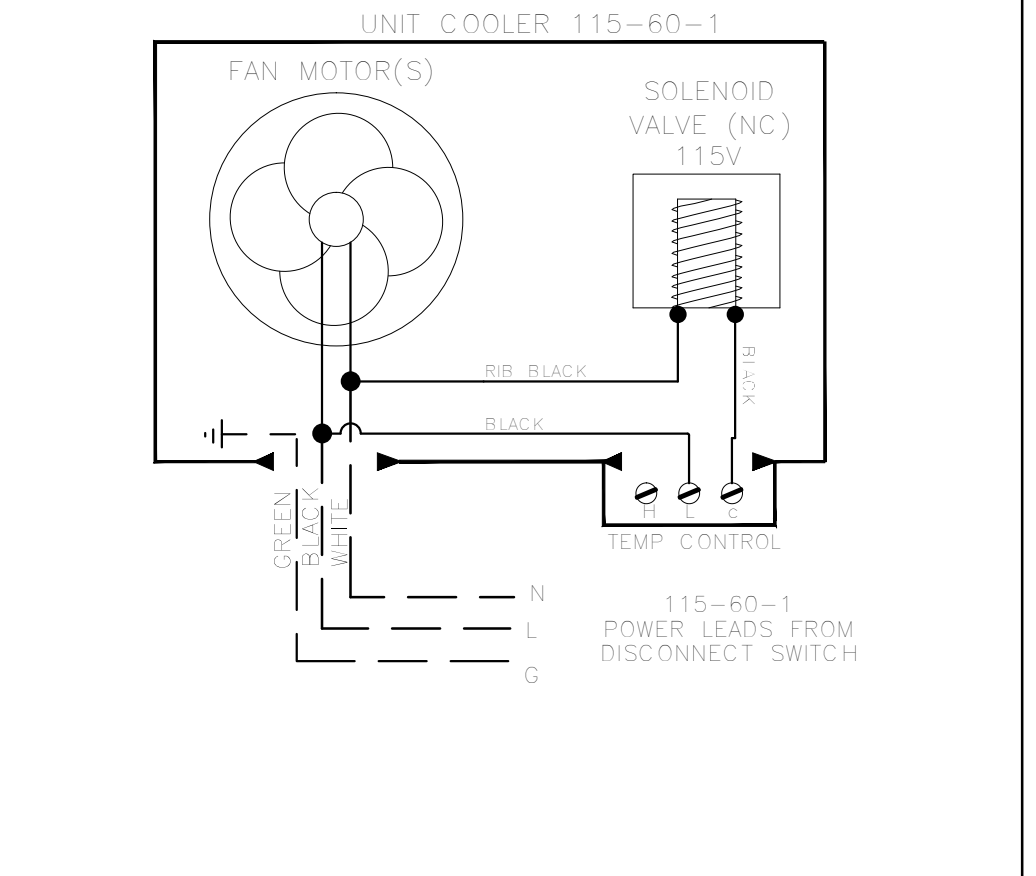

WIRING DIAGRAM AIR DEFROST EVAP.
N.T.S. 8

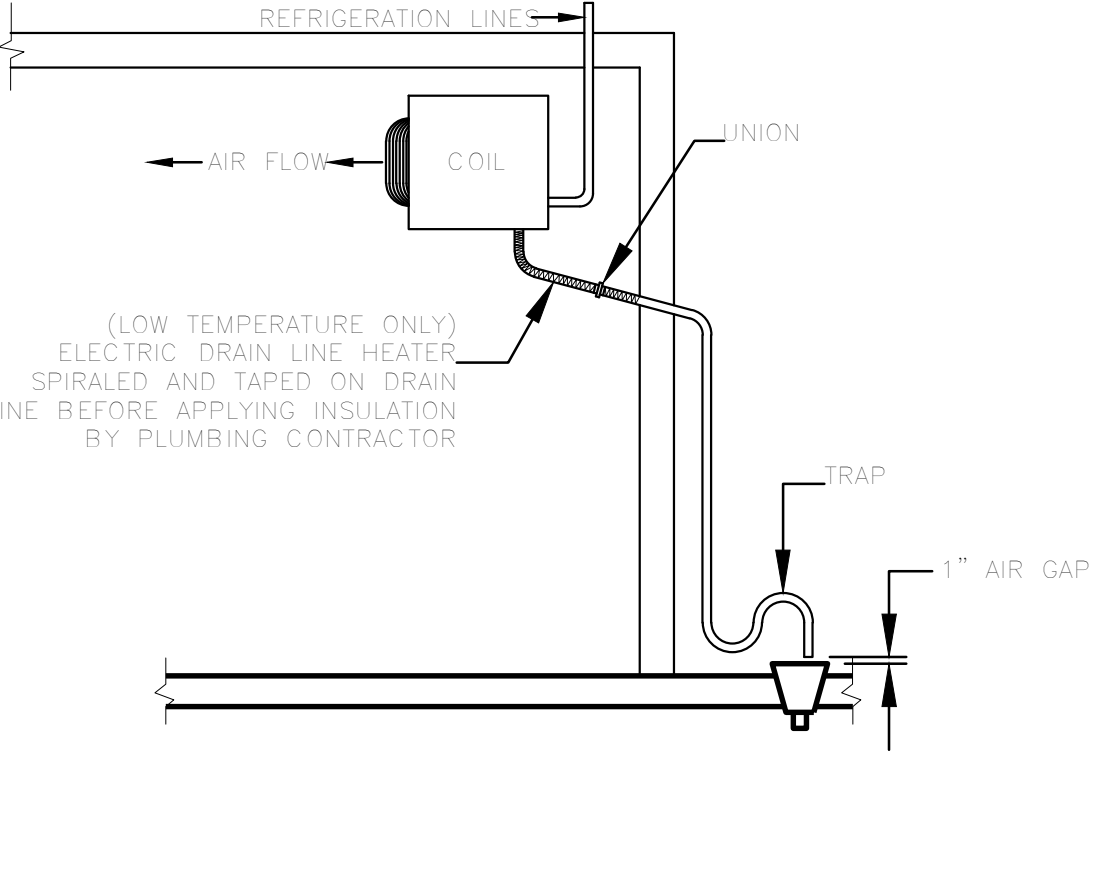

DRAIN LINE DETAILS
N.T.S. 9

- THE "MULTI-PAK" MC3 REMOTE CONDENSING UNIT PACKAGE SHALL BE A COMPLETE FACTORY ASSEMBLED UNIT MANUFACTURED BY ROI REFRIGERATION, A DIVISION OF THE MANITOWOC REFRIGERATION GROUP, 81 HOLLY STREET, EXT., PARSONS, TN 38363, PHONE: (731) 847-5317, FAX: (731) 847-9012.
- MULTI-PAK REFRIGERATION SYSTEM**
 - THE UNIT IS TO BE WEATHERPROOF AND SHALL BE CONSTRUCTED OF G90 GALVANIZED METAL. THE UNIT SHALL BE PROVIDED WITH MULTI-CIRCUIT AIR COOLED CONDENSER FOR WALK-IN COOLER AND FREEZER, MANITOWOC "CVO" ICE MACHINE, AND CONDENSER CIRCUITS ONLY FOR A MANITOWOC ICE MACHINE. ALL SUCTION LINES MUST BE INSULATED WITH A MINIMUM OF 1/2" "ARMAFLEX" INSULATION.
 - REFRIGERATION UNITS**
 - CRANKCASE HEATERS SHALL BE PROVIDED WITH EACH COMPRESSOR. THE CRANKCASE HEATERS SHALL ONLY OPERATE ON THE COMPRESSOR OFF CYCLE.
 - THE COMPRESSORS SHALL BE HERMETIC TYPE (COPELAND). EACH UNIT SHALL BE EQUIPPED WITH DUAL PRESSURE CONTROLS, LIQUID LINE DRIER, SIGHT GLASS, AND HEAD PRESSURE CONTROL VALVES.
 - ALL COMPRESSORS SHALL BE NEW AND FACTORY ASSEMBLED TO OPERATE WITH THE SPECIFIED REFRIGERANT.
 - PRE-PIPING**
 - ALL COPPER SHALL BE REFRIGERANT GRADE A.C.R. OR TYPE "L".
 - ALL TUBING SHALL BE SECURELY SUPPORTED WITH BRACKETS AND CLAMPS.
 - ALL REFRIGERANT LINES SHALL BE EXTENDED TO ONE END OF THE RACK IN A NEAT AND ORDERLY MANNER.
 - SILVER SOLDER AND/OR SIL-FOS SHALL BE USED FOR ALL REFRIGERANT LINE BRAZED JOINTS. SOFT SOLDER IS NOT ACCEPTABLE.
 - ALL PIPING SHALL BE TESTED WITH DRY NITROGEN AT 300 PSI. AFTER THE CONDENSING UNIT AND EVAPORATOR COILS HAVE BEEN CONNECTED, THE ENTIRE SYSTEM SHALL BE LEAK TESTED WITH ALL VALVES IN THE OPEN POSITION.

- GENERAL NOTES**
- GENERAL CONTRACTOR**
 - CONTRACTORS SHALL VERIFY ALL DIMENSIONS AND COORDINATE WITH ALL TRADES INVOLVED.
 - GENERAL CONTRACTOR SHALL PROVIDE AND PREPARE WEATHERPROOFED PLATFORM, AND/OR CURBED OPENINGS.
 - REFRIGERATION CONTRACTOR**
 - THE COMPLETE SYSTEM SHALL BE EVACUATED WITH A VACUUM PUMP PRIOR TO CHARGING.
 - ALL COPPER TUBING SHALL BE REFRIGERANT GRADE A.C.R. OR TYPE "L".
 - CHARGE, TEST, AND ADJUST EACH UNIT TO ASSURE PROPER OPERATION.
 - SILVER SOLDER AND/OR SIL-FOS SHALL BE USED FOR ALL REFRIGERANT PIPING. SOFT SOLDER IS NOT ACCEPTABLE.
 - ALL PIPING TO BE PRESSURE TESTED WITH DRY NITROGEN AT 300 PSI. AFTER THE CONDENSING UNIT AND EVAPORATOR COILS HAVE BEEN CONNECTED, THE BALANCE OF THE SYSTEM SHALL BE LEAK TESTED WITH ALL VALVES IN THE OPEN POSITION.
 - REFRIGERATION CONTRACTOR SHALL PROVIDE AND INSTALL A DRAIN LINE HEATER IN THE FREEZER COMPARTMENT. HEATER TO BE CONNECTED BY THE ELECTRICAL CONTRACTOR.
 - ELECTRICAL CONTRACTOR**
 - ELECTRICAL CONTRACTOR SHALL CONNECT DRAIN LINE HEATER IN THE FREEZER COMPARTMENT.
 - ELECTRICAL CONTRACTOR SHALL PROVIDE POWER FOR THE REFRIGERATION PACKAGE AND CONNECT CONTROL AND DEFROST SYSTEM AS INDICATED IN THE WIRING DIAGRAM.
 - ELECTRICAL CONTRACTOR SHALL PROVIDE COLOR CODED WIRING FROM TIME CLOCK AT THE REFRIGERATION PACKAGE TO THE EVAPORATOR COIL IN THE FIXTURE FOR PROPER DEFROST.
 - ALL ELECTRICAL WIRING AND INSTALLATION SHALL BE IN ACCORDANCE WITH THE WIRING DIAGRAM AND NATIONAL AND LOCAL CODES.
 - PLUMBING CONTRACTOR**
 - REFRIGERATION CONTRACTOR SHALL PROVIDE HARD A.C.R. OR TYPE "L" COPPER DRAIN LINES FOR WALK-IN COOLER AND FREEZER, PITCHED 1/2" PER FOOT OF RUN. IN FREEZER, UNHEATED DRAIN LINE MUST BE OUTSIDE OF REFRIGERATED SPACE TO PREVENT FREEZING. TRAP DRAIN LINE OUTSIDE OF REFRIGERATED SPACE TO AVOID ENTRANCE OF WARM MOIST AIR.
 - REFRIGERATION CONTRACTORS TO PROVIDE INDIVIDUAL DRAIN LINE FOR EACH EVAPORATOR UNLESS OTHERWISE SPECIFIED.
 - ALL PLUMBING INSTALLATION SHALL BE IN ACCORDANCE WITH NATIONAL AND LOCAL CODES.

- REFRIGERATION SYSTEM SPECS.**
N.T.S. 6
- ITEMS PROVIDED INCLUDE:
- 3 FAN MULTI-CIRCUIT CONDENSER
 - (3)COND FAN MOTOR-1/2 HP
 - SIGHT GLASS
 - LIQUID LINE FILTER DRIER
 - LIQUID LINE SOLENOID VALVE (INSTALLED-EVAP)
 - THERMOSTAT (INSTALLED-EVAP)
 - HEADMASTER HEAD PRESSURE CONTROL
 - HERMETIC COMPRESSORS-COPELAND
 - CRANKCASE HEATERS
 - HI/LO PRESSURE CONTROL (ADJUSTABLE)
 - OUTDOOR HOUSING-G90 GALVANIZED
 - CRANKCASE HEATER
 - CIRCUIT BREAKER EA UNIT
 - SINGLE POINT ELEC. FUSED DISC.(MTD.)
 - TIMER MOUNTED ON ALL UNITS

PROVIDED ITEM NOTES
N.T.S. 10



erstad ARCHITECTS, P.A.
310 North 4th Street, Boise, Idaho 83702
(208) 331-9031 www.erstadarchitects.com

This document is the property of erstad ARCHITECTS and is protected by U.S. and International laws. Use, reproduction or modification of this document without first obtaining the written permission of erstad architects is prohibited. This document may not be used in any unauthorized manner. © 2016

PROTOTYPE T27-C-54 24608 - CONTEMPORARY STAR
1230 N. Division Street,
Spokane, WA 99202

PROJECT: 151101
DATE: 06/10/16
DRAWN: kk/js
CHECKED: jh


Permit Set

DATE	DESCRIPTION


REFRIGERATION PLAN, SCHEDULES, AND DETAILS

K2.0


#9080/1102578

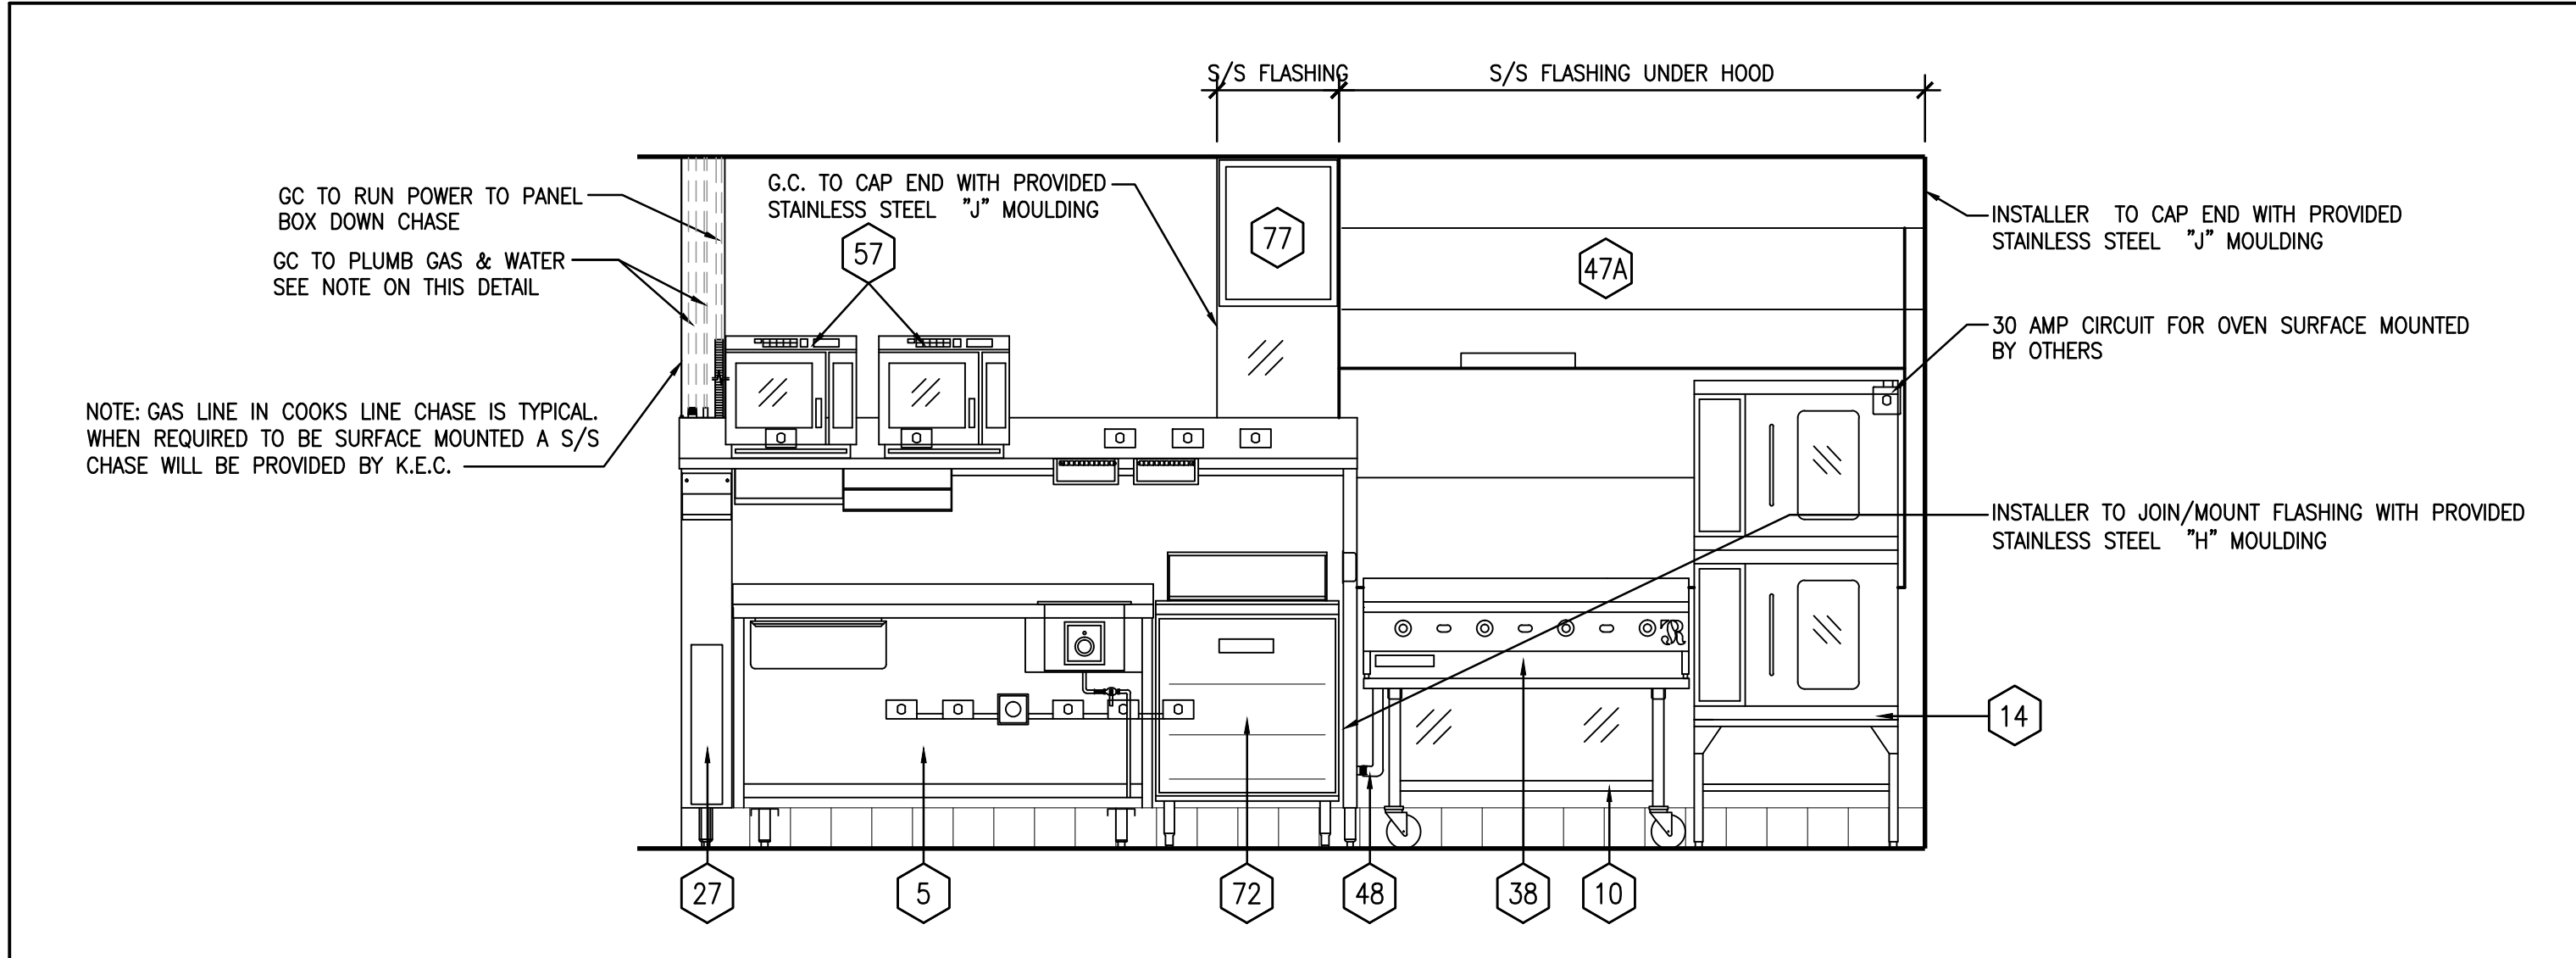


BACK COOKLINE LAYOUT
N.T.S. 3

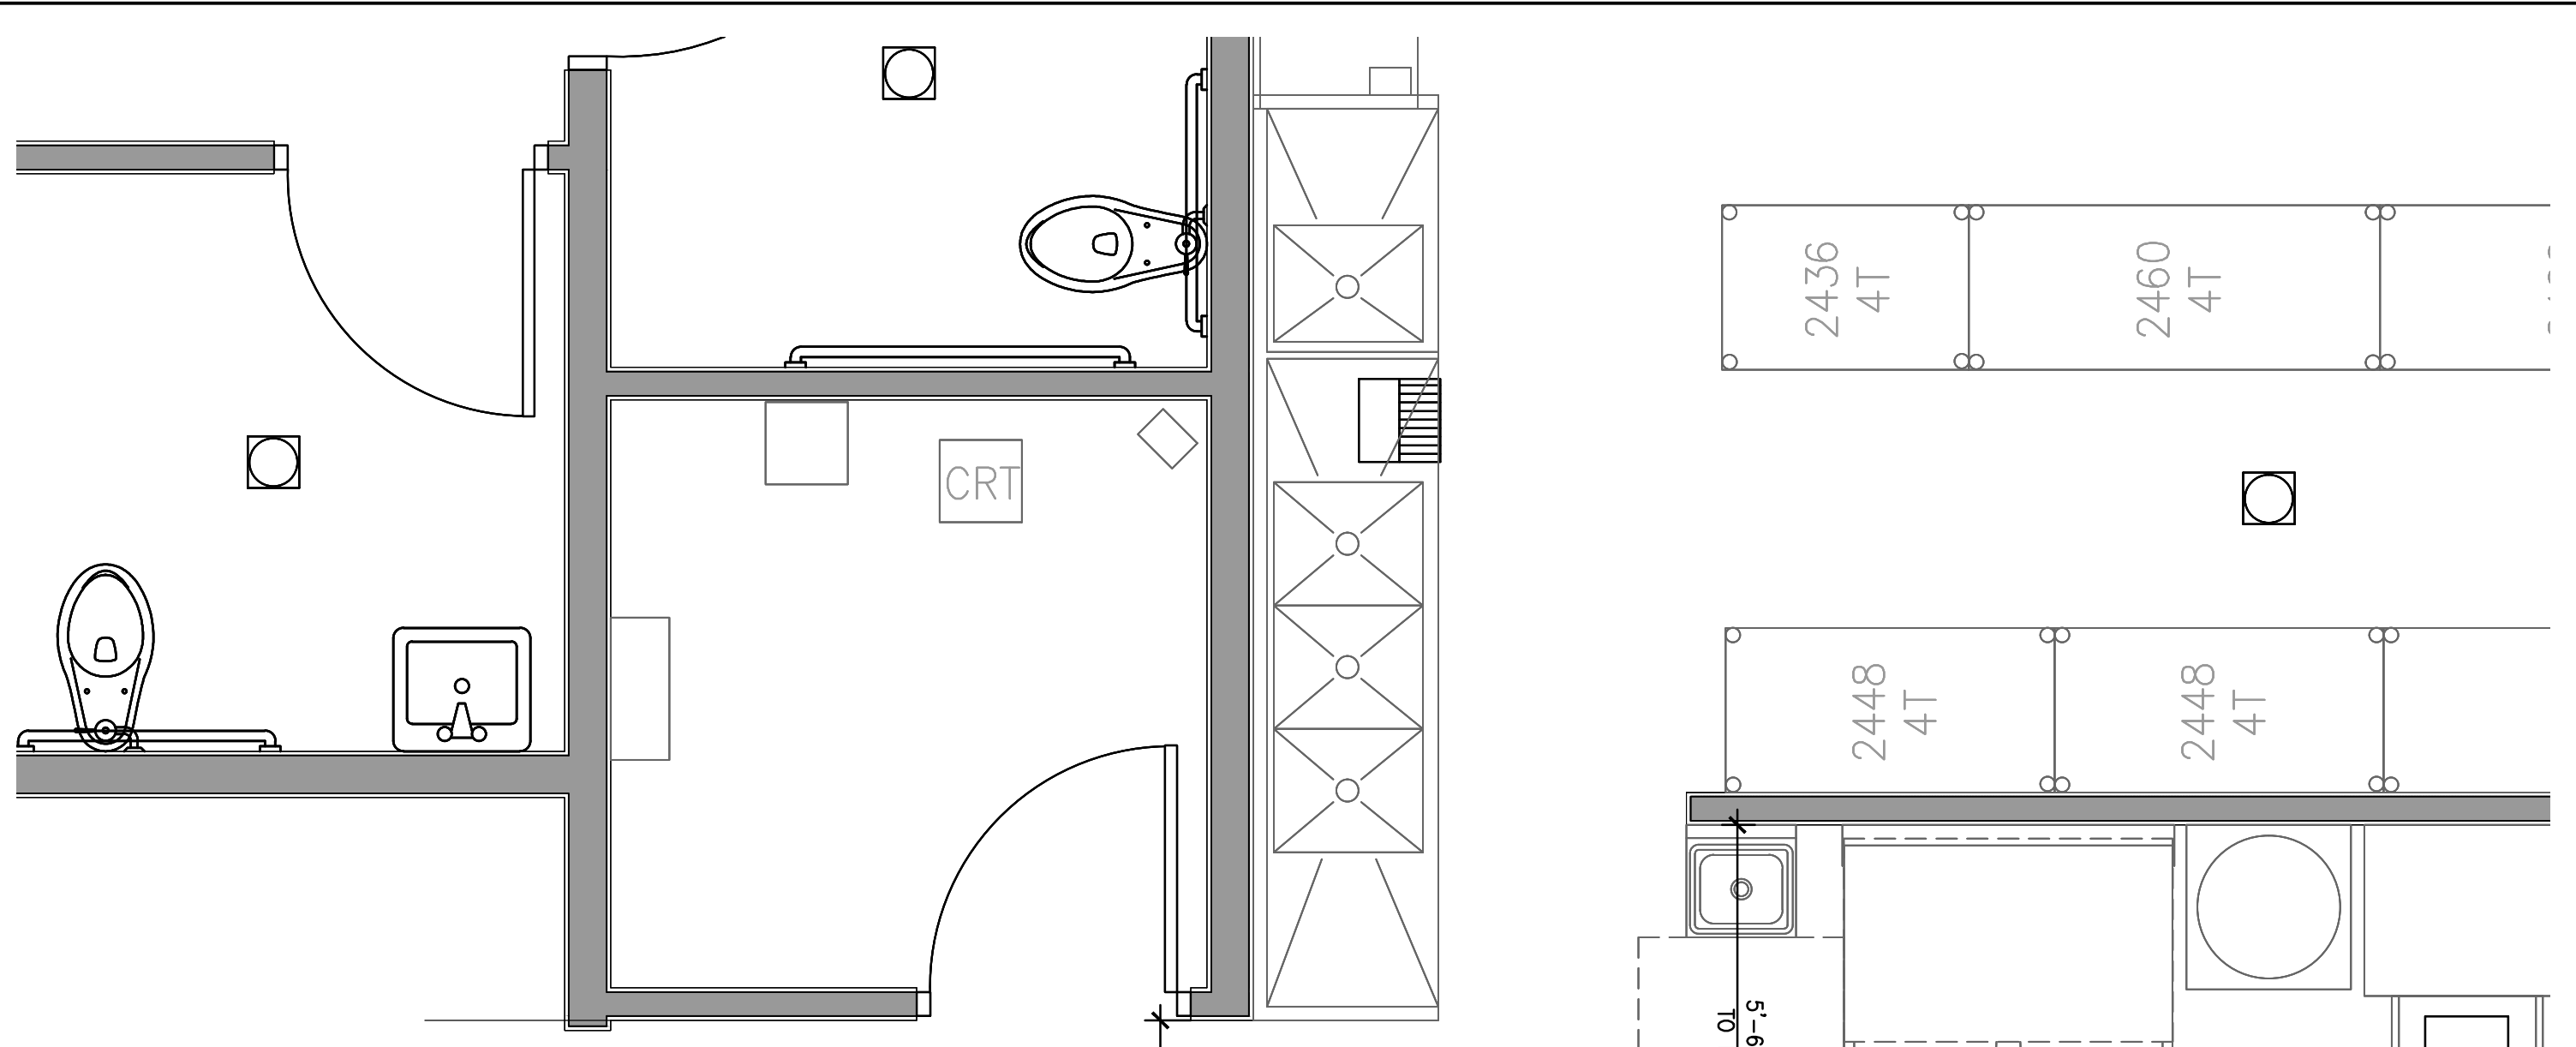


KITCHEN EQUIPMENT LAYOUT
1/2" = 1'-0" 1

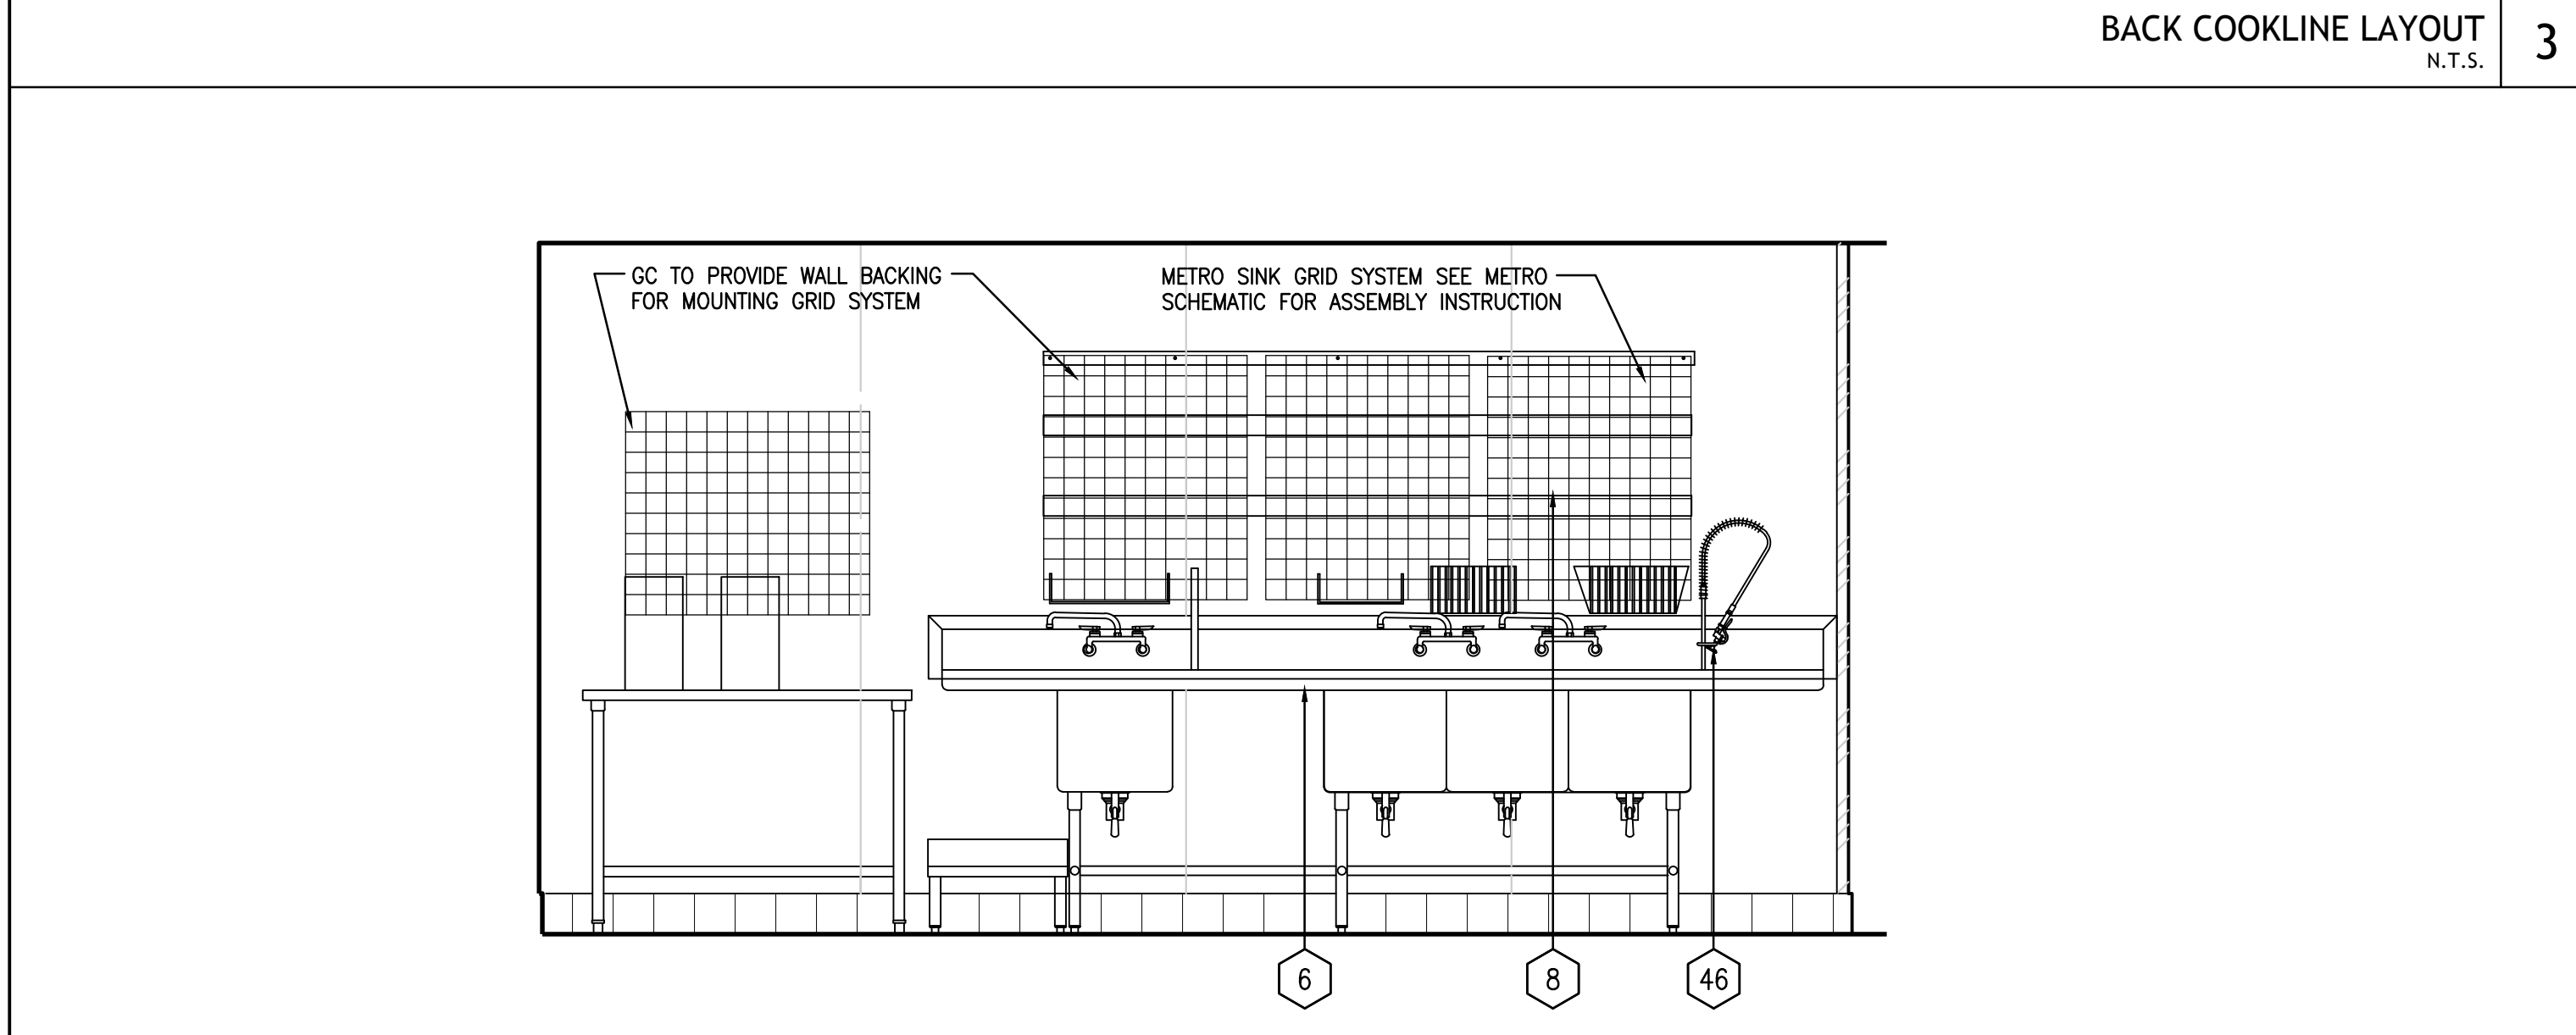


SCULLERY LAYOUT
N.T.S. 4

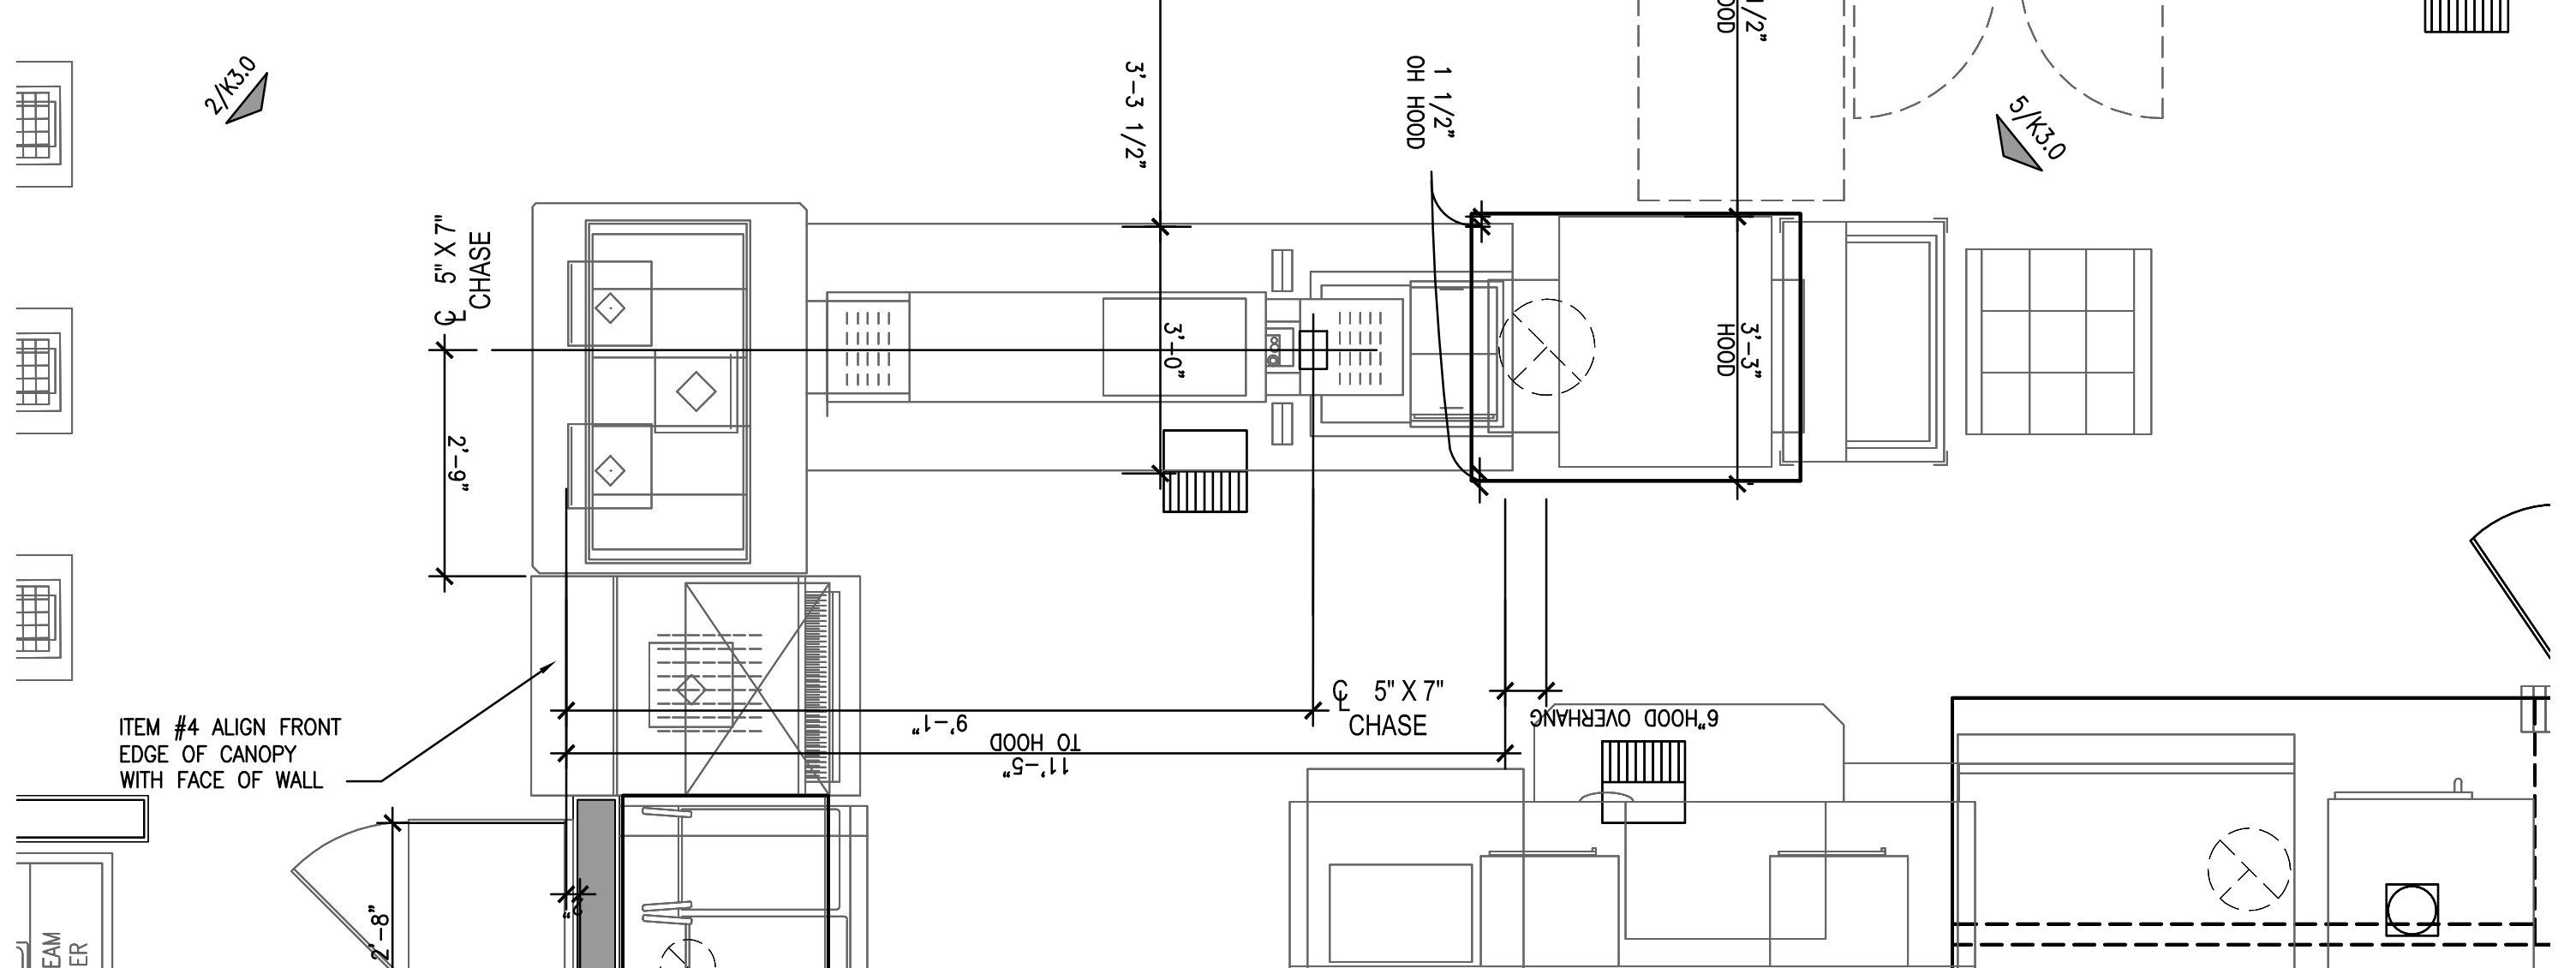



MAIN COOKLINE (REAR LEFT VIEW)
N.T.S. 5



NOT USED
N.T.S. 6

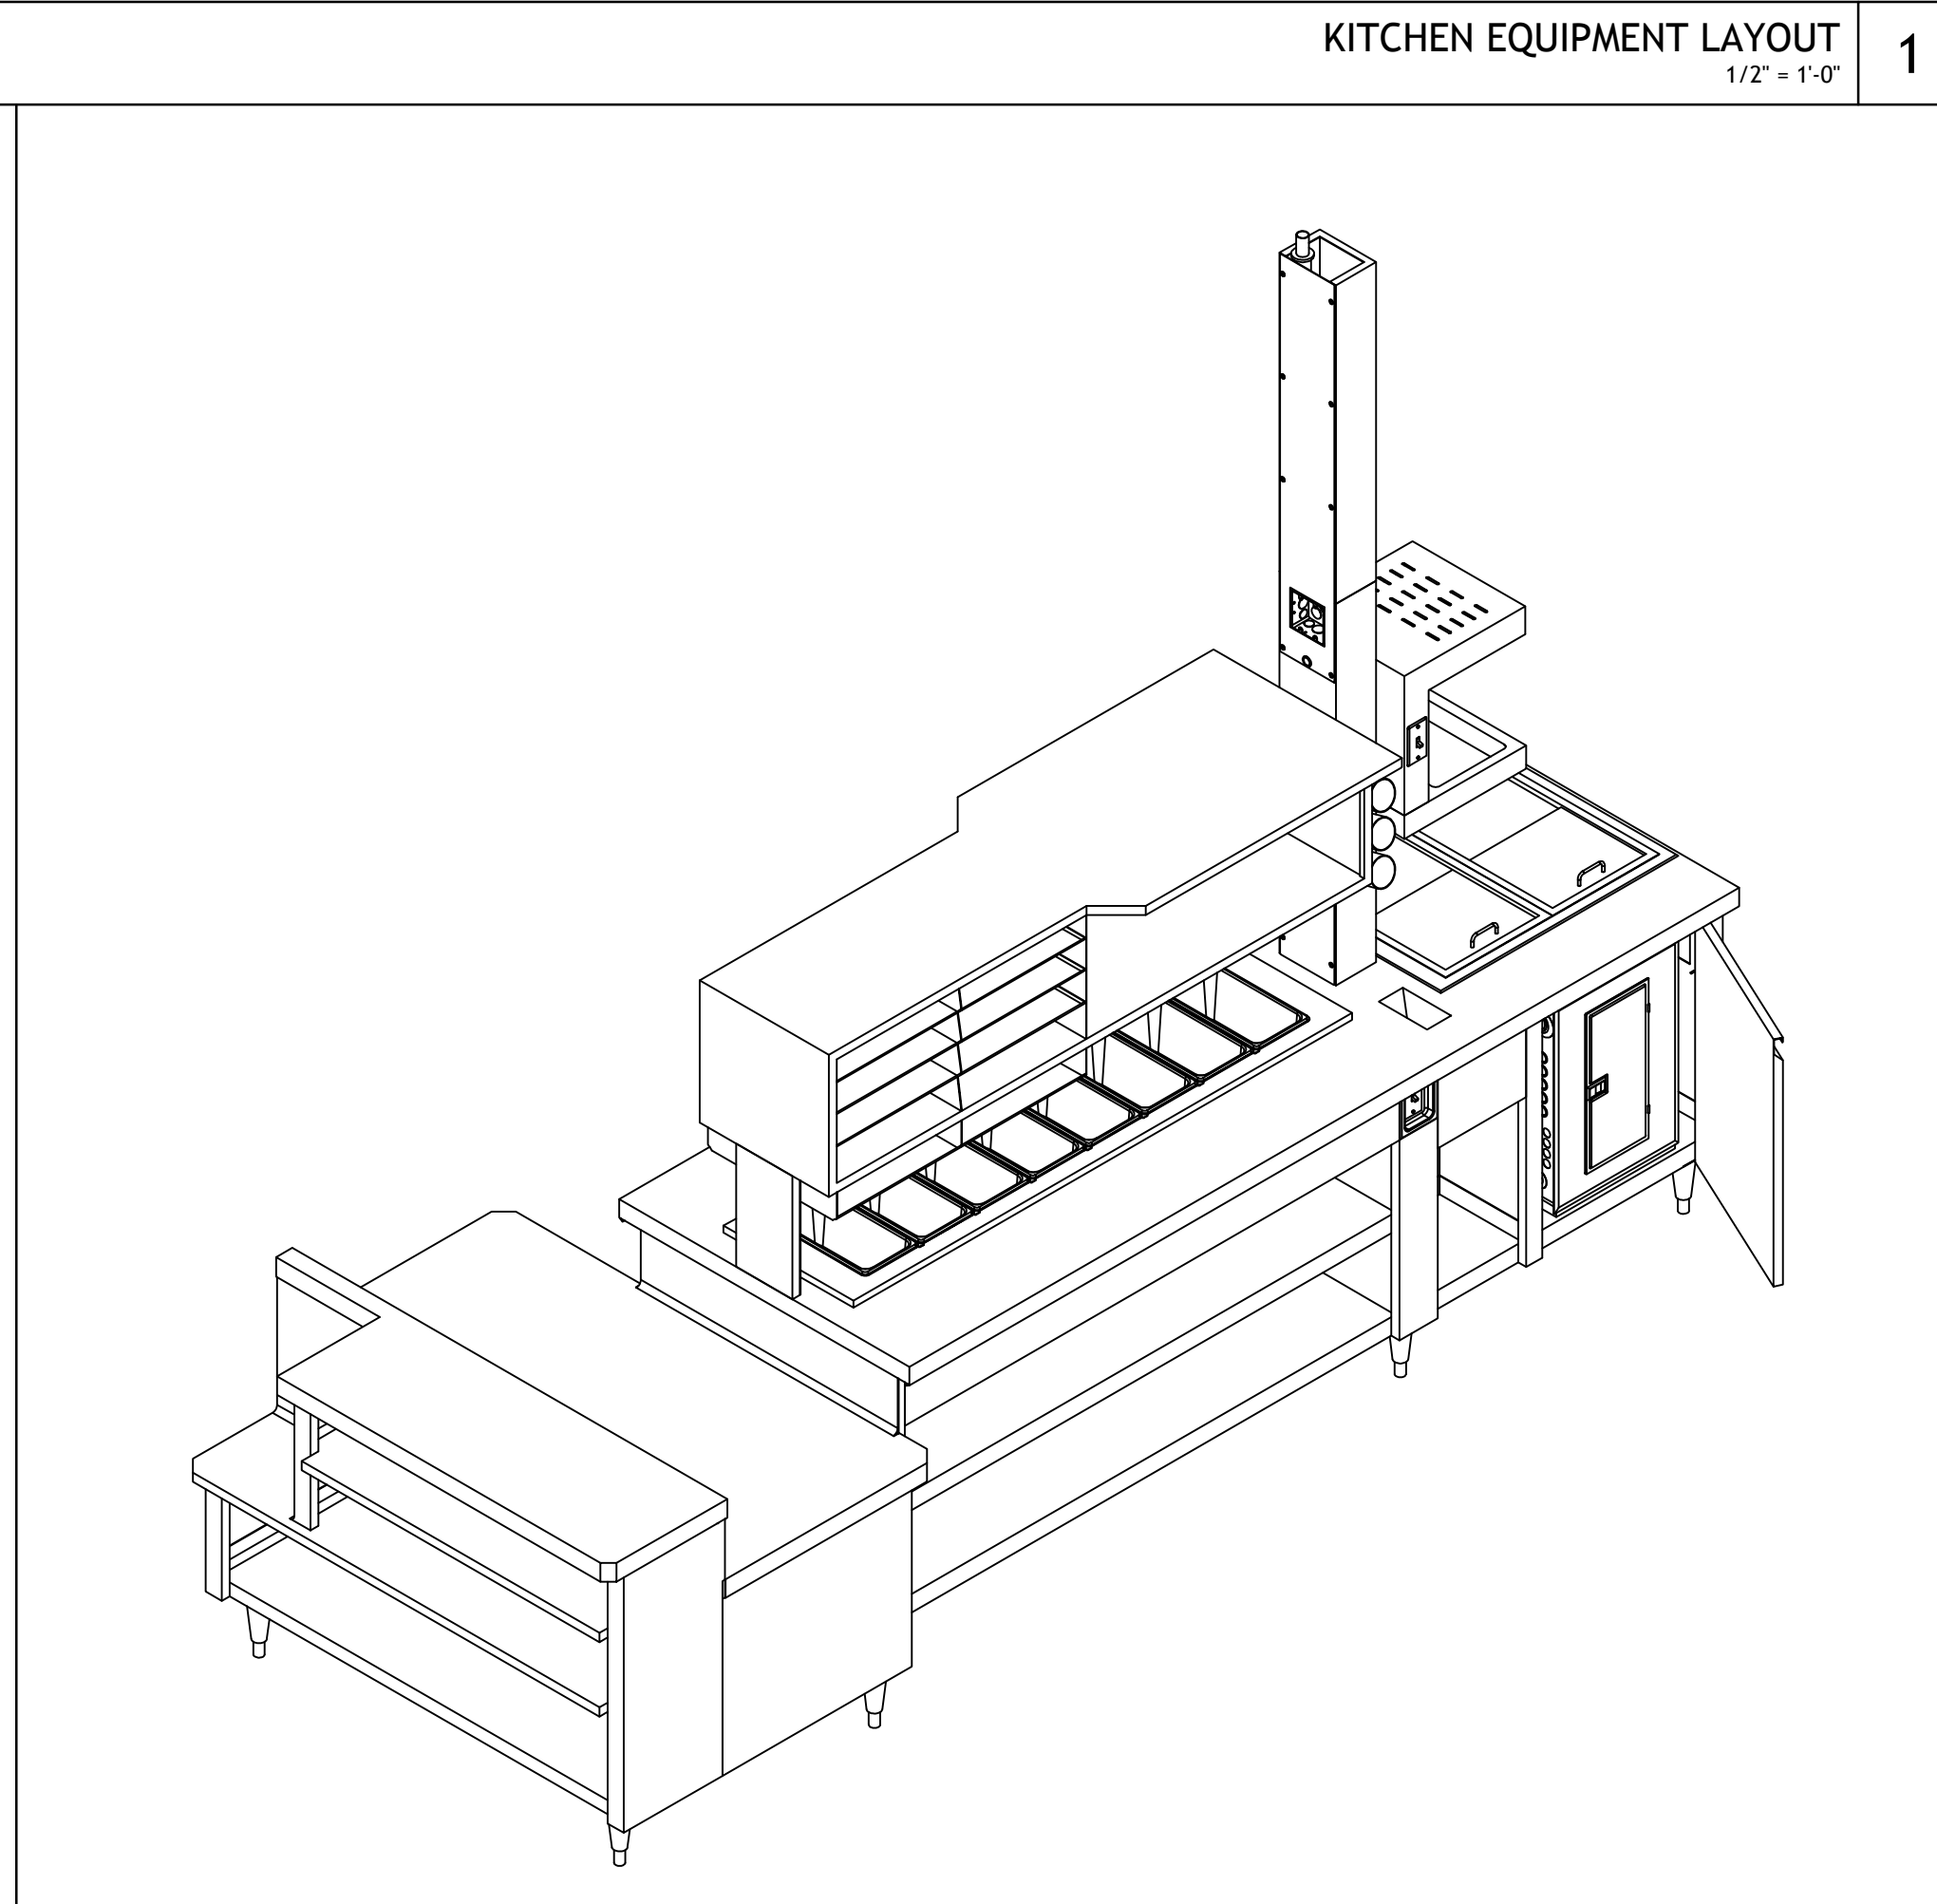

MAIN COOKLINE (FRONT RIGHT VIEW)
N.T.S. 2

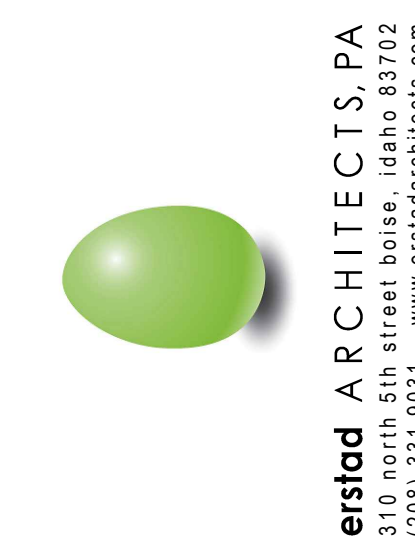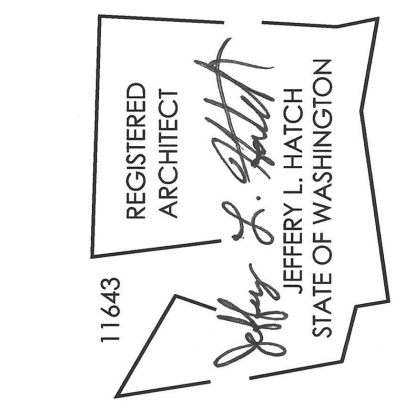

This document is the property of erstad ARCHITECTS and is protected by U.S. and international laws. Use, reproduction or modification of this document without first obtaining the written permission of erstad architects is prohibited. This document may not be used in any unauthorized manner. ©2016

PROTOTYPE T27-C-54 2460.8 - CONTEMPORARY STAR
1230 N. Division Street,
Spokane, WA 99202

PROJECT: 151101
DATE: 06/10/16
DRAWN: kk/js
CHECKED: jh

Permit Set


DATE	DESCRIPTION

SHEET TITLE:
EQUIPMENT DETAILS


SHEET NUMBER:

K3.0

#9080/1102578

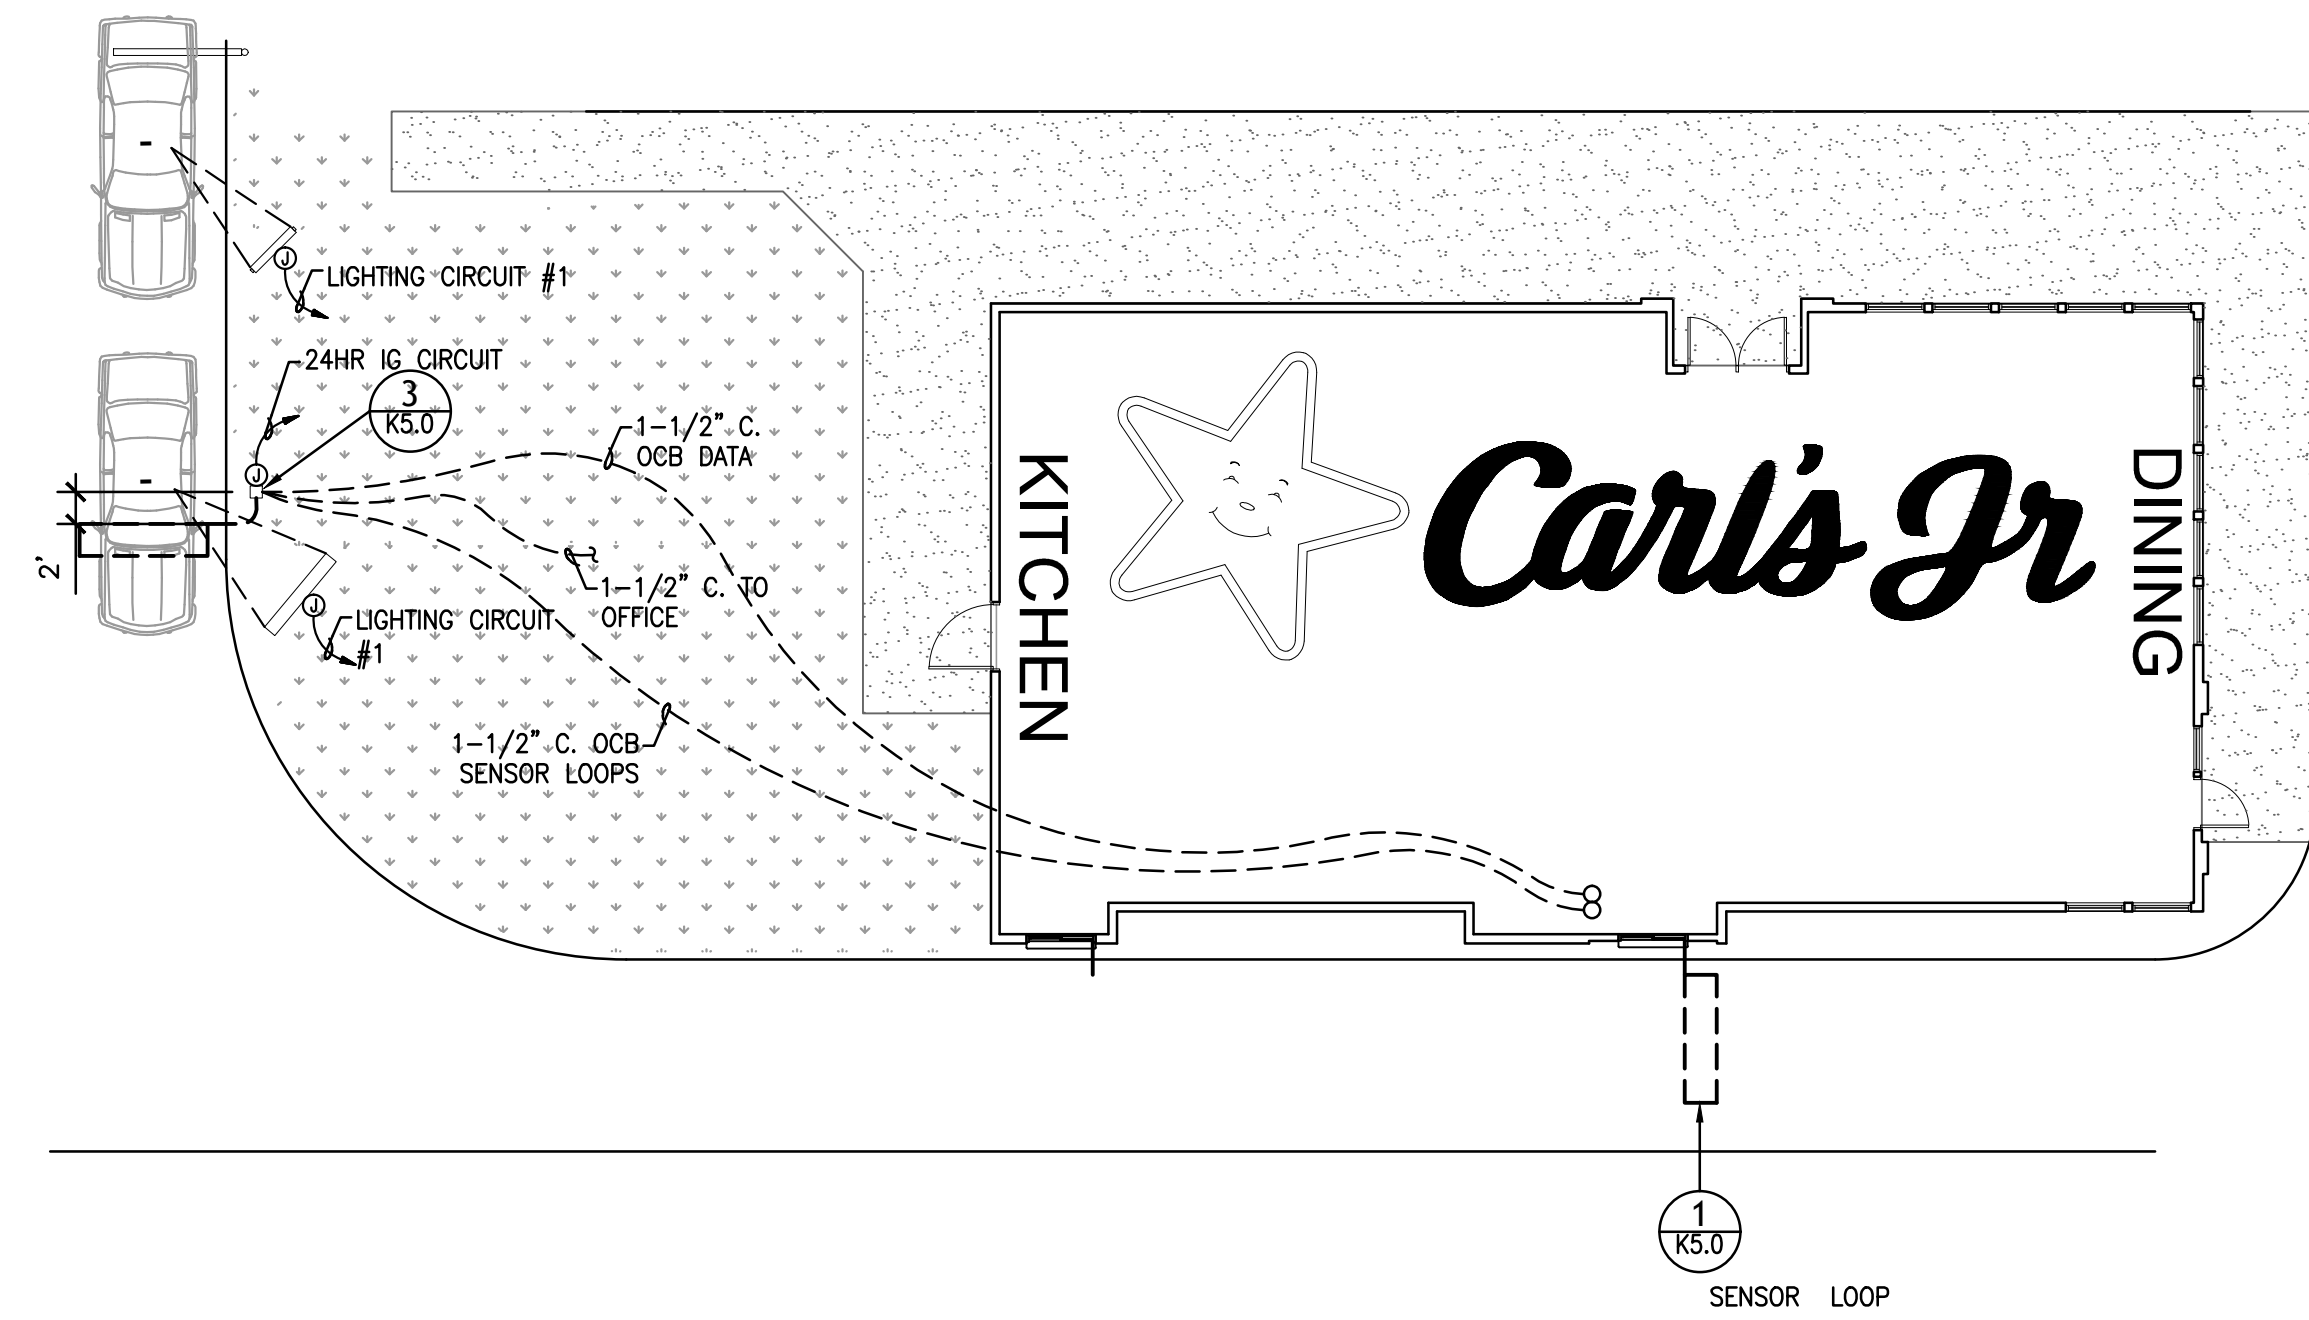


SENSOR LOOP LAYOUT
N.T.S. 2

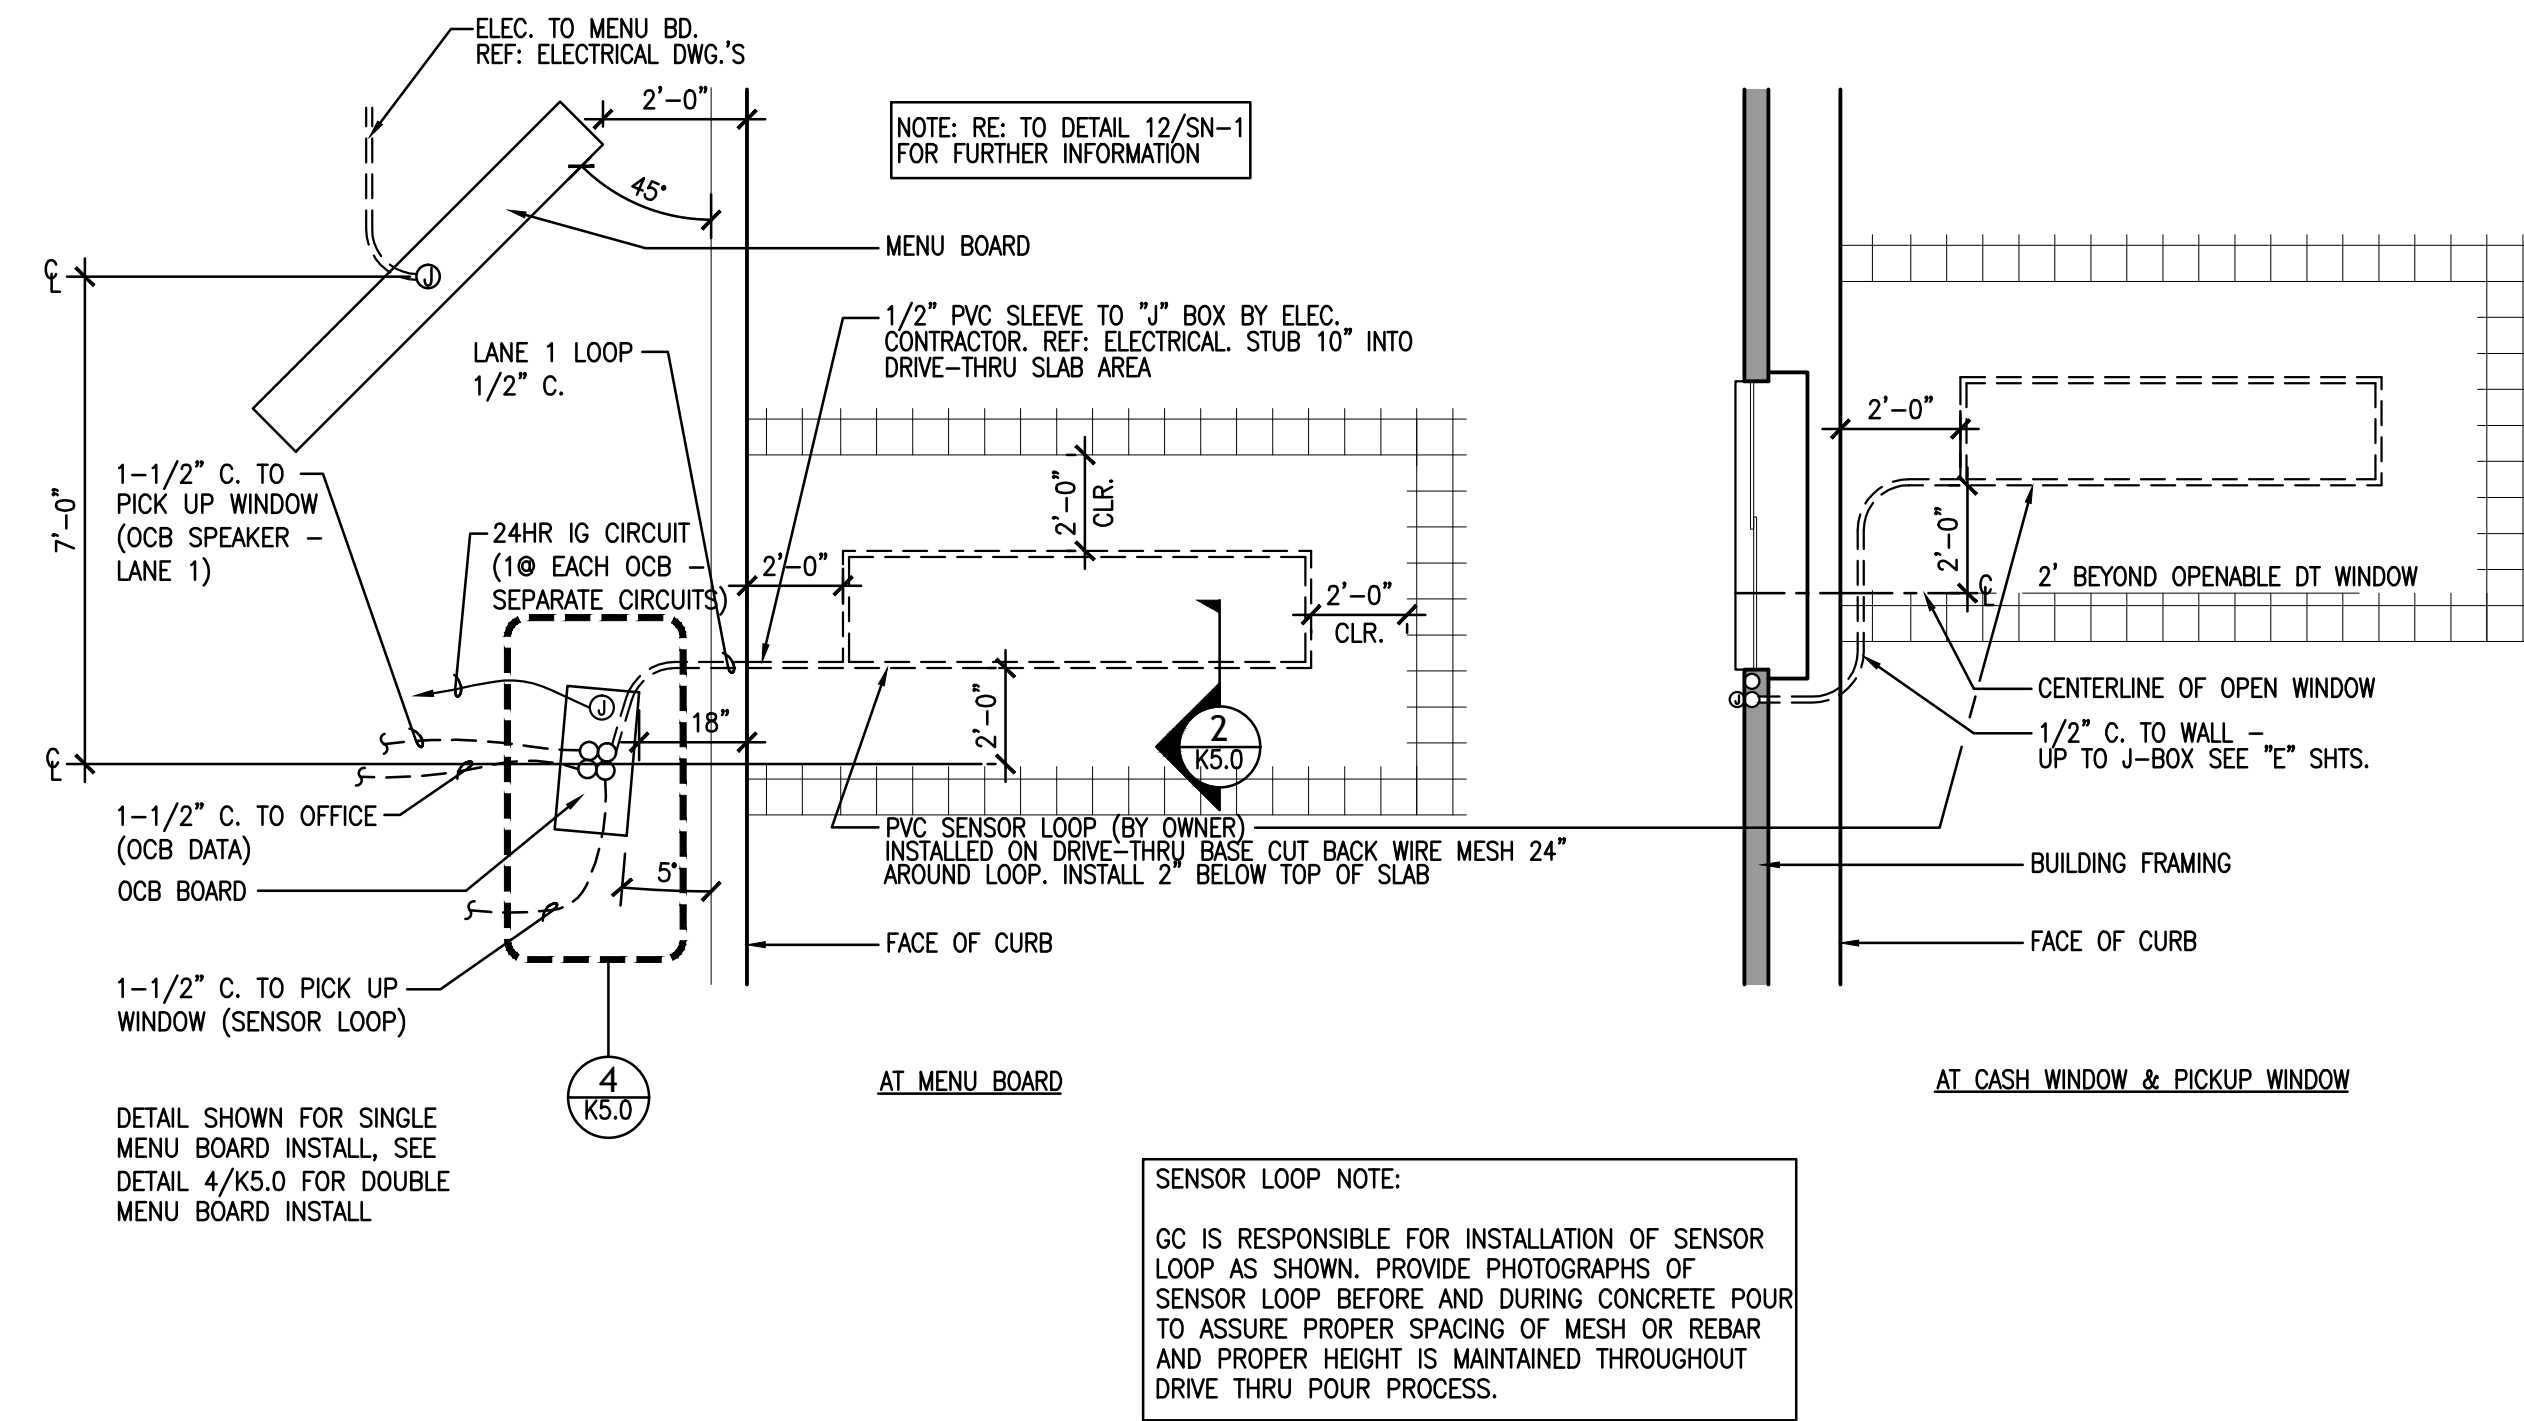


SENSOR LOOP NOTE:
GC IS RESPONSIBLE FOR INSTALLATION OF SENSOR LOOP AS SHOWN. PROVIDE PHOTOGRAPHS OF SENSOR LOOP BEFORE AND DURING CONCRETE POUR TO ASSURE PROPER SPACING OF MESH OR REBAR AND PROPER HEIGHT IS MAINTAINED THROUGHOUT DRIVE THRU POUR PROCESS.

SENSOR LOOP DETAIL (OVER VIEW)
N.T.S. 1

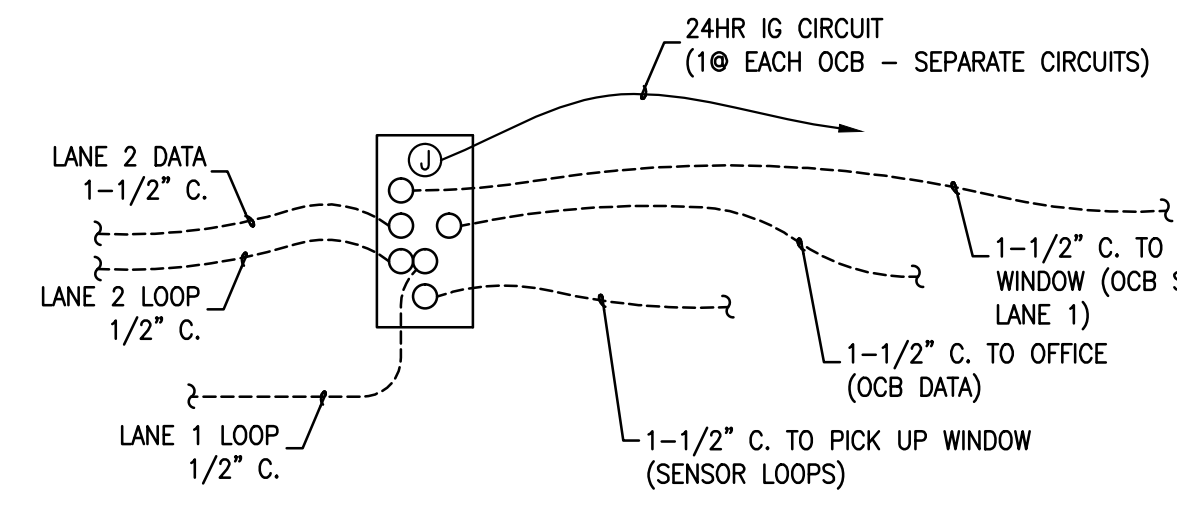

LANE 1 OCB LINE DIAGRAM W/ DDT CONDITION
N.T.S. 4

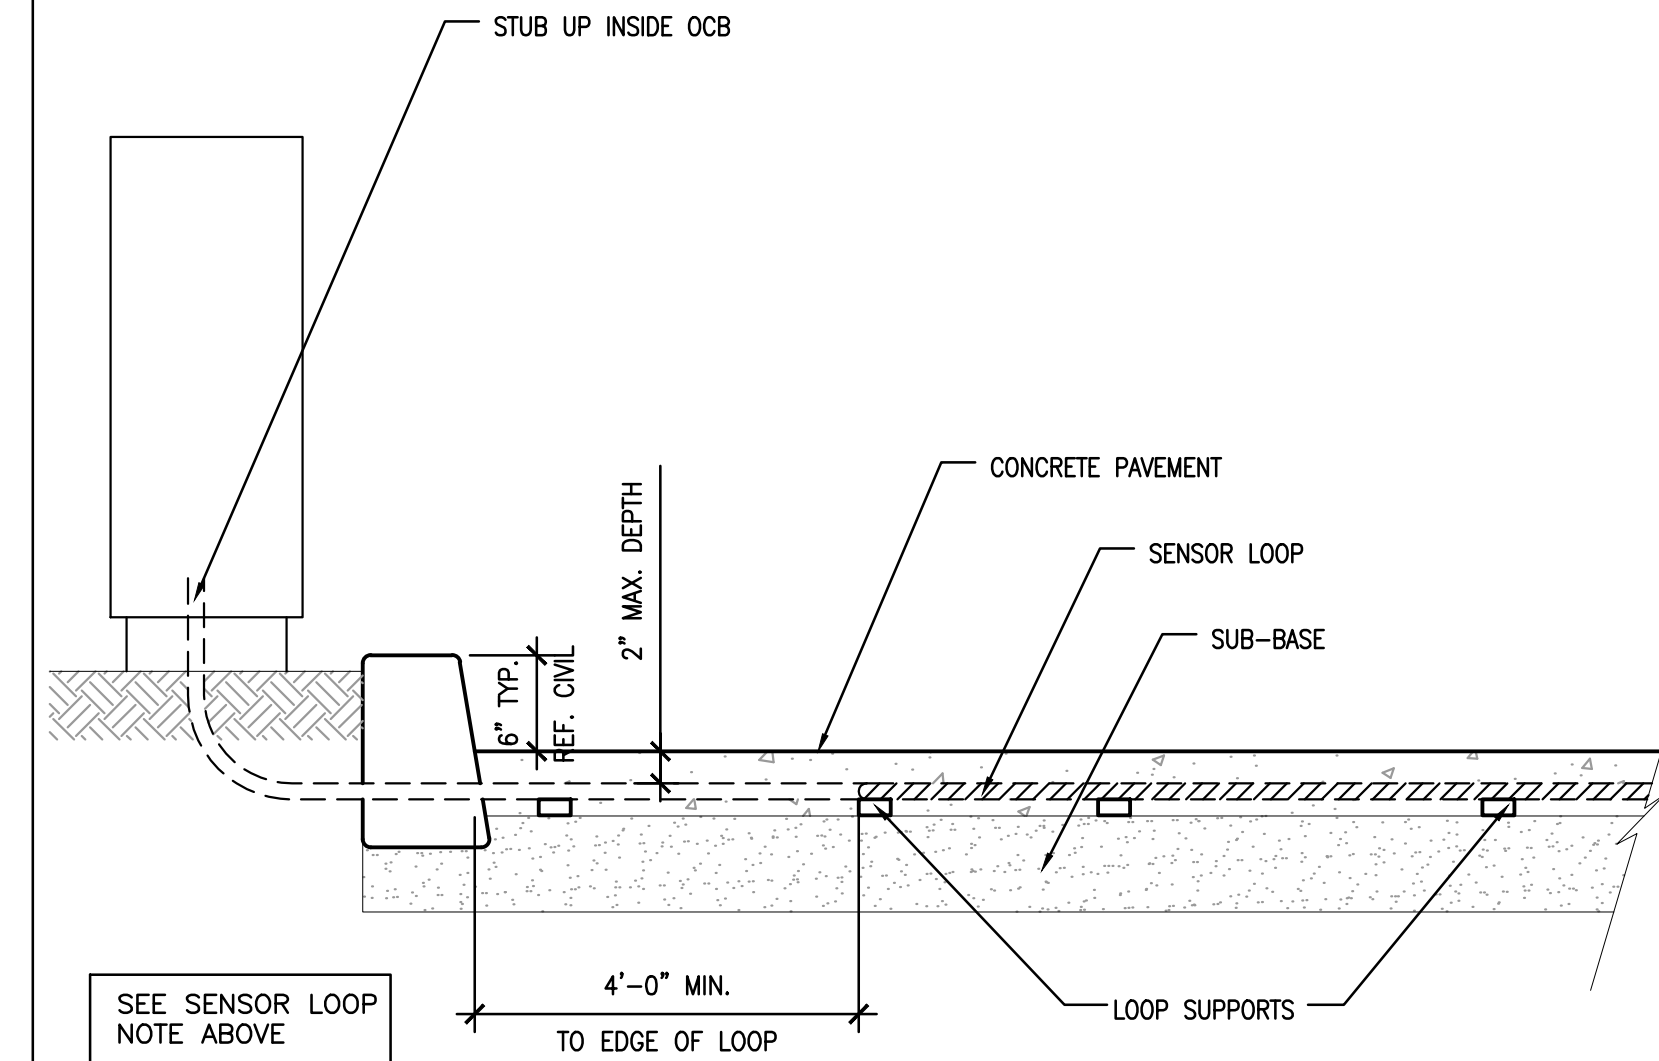


SENSOR LOOP DETAIL (OVER VIEW)
N.T.S. 2

PREVIEW, OCB, AND MENU BOARD LAYOUT OPTIONS
N.T.S. 7

NOT USED
N.T.S. 5

NOT USED
N.T.S. 3

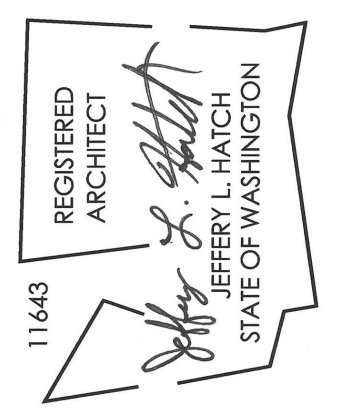

erstad ARCHITECTS, P.A.
310 North 4th Street, Suite 100, Spokane, WA 99202
(509) 325-9331 www.erstadarchitects.com

This document is the property of erstad ARCHITECTS and is protected by U.S. and international laws. Use, reproduction or modification of this document without first obtaining the written permission of erstad architects is prohibited. This document may not be used in any unauthorized manner. ©2016

Carli's Jr.
PROTOTYPING T27-C-54 24608 - CONTEMPORARY STAR
1230 N. Division Street,
Spokane, WA 99202

PROJECT: 151101
DATE: 06/10/16
DRAWN: kk/js
CHECKED: jh

Permit Set

DATE	DESCRIPTION

SHEET TITLE:
DRIVE-THRU PLAN AND SENSOR LOOP INSTALLATION DETAILS

SHEET NUMBER:
K5.0

#9080/1102578